

# BART Analysis for Fort Churchill Unit 1

Prepared For:

**NV Energy**

6100 Neil Road  
Reno, NV 89520-0024

Revised Report  
October 2008

Prepared By:



2285 Corporate Circle  
Henderson, NV 89074

# Executive Summary

---

## Background

In response to the Regional Haze Rule and Best Available Retrofit Technology (BART) regulations and guidelines, CH2M HILL was requested to perform a BART analysis for NV Energy (NVE) Fort Churchill Unit 1 (hereafter referred to as Fort Churchill 1). A BART analysis has been conducted for the following criteria pollutants: oxides of nitrogen (NO<sub>x</sub>), sulfur dioxide (SO<sub>2</sub>), and particulate matter less than 10 microns in aerodynamic diameter (PM<sub>10</sub>). The Fort Churchill Station consists of two nominal 113 BART eligible megawatt (MW) units with a total nominal generating capacity of 226 MW. The fuel currently utilized in Fort Churchill Unit 1 is Pipeline Quality Natural Gas (PNG) or a blended fuel oil. BART must be implemented within 5 years after the State Implementation Plan (SIP) is approved by the EPA, and a compliance date of 2015 was assumed for this analysis.

In completing the BART analysis, technology alternatives were investigated and potential reductions in NO<sub>x</sub>, SO<sub>2</sub>, and PM<sub>10</sub> emissions rates were identified for when the unit is burning 1) 100 percent PNG, 2) 100 percent No. 6 fuel oil, and 3) 100 percent No. 2 fuel oil. The following technology alternatives were investigated for the PNG and both fuel oil alternatives and are listed below by pollutant:

NO<sub>x</sub> emission controls:

- Low NO<sub>x</sub> Burners (LNB)
- Low NO<sub>x</sub> Burners (LNB) with Flue Gas Recirculation (FGR)
- Low NO<sub>x</sub> Burners (LNB) with selective non-catalytic reduction system (SNCR)
- Rotating opposed fire air (ROFA) with Rotamix
- LNB with selective catalytic reduction (SCR) system

SO<sub>2</sub> emission controls:

- Use of low-sulfur fuel
- Spray Dryer Absorber (SDA)

PM<sub>10</sub> emission controls:

- Use of low sulfur fuel oil (No. 2 fuel oil) and LNB
- Dry Electrostatic Precipitator
- Wet Electrostatic Precipitator
- Fabric filter

## BART Engineering Analysis

The specific steps in a BART engineering analysis are identified in the Code of Federal Regulations (CFR) at 40 CFR 51 Appendix Y, Section IV. The evaluation must include the following:

1. The identification of available, technically feasible, retrofit control options
2. Consideration of any pollution control equipment in use at the source (which affects the availability of options and their impacts)
3. The costs of compliance with the control options
4. The remaining useful life of the facility
5. The energy and non-air quality environmental impacts of compliance
6. The degree of visibility improvement which may reasonably be anticipated from the use of BART

These steps are incorporated into the BART analysis as follows:

#### **Step 1 – Identify All Available Retrofit Control Technologies**

#### **Step 2 – Eliminate Technically Infeasible Options**

- The identification of available, technically feasible, retrofit control options
- Consideration of any pollution control equipment in use at the source (which affects the applicability of options and their impacts)

#### **Step 3 – Evaluate Control Effectiveness of Remaining Control Technologies**

- Costs associated with control technologies are summarized in the economic analysis presented in Appendix A. For clarity, Appendix A also includes sample economic analysis spreadsheet calculations and explanation of assumptions used.

#### **Step 4 – Evaluate Energy and Non-Air Quality Impacts**

- The costs of compliance with the control options
- The remaining useful life of the facility
- The energy and non-air quality environmental impacts of compliance

#### **Step 5 – Evaluate Visibility Impacts**

- The degree of visibility improvement which may reasonably be anticipated from the use of BART

Separate analyses have been conducted for NO<sub>x</sub>, SO<sub>2</sub>, and PM<sub>10</sub> emissions. All costs included in the BART analyses are in 2007 dollars, and costs have not been escalated to the assumed 2015 BART implementation date.

### **Establishing Emission Reduction Levels from BART Analysis Results**

As an integral part of the BART analysis process, cost and expected emission information was developed for NO<sub>x</sub>, SO<sub>2</sub>, and PM<sub>10</sub>. This information is assembled from various sources including emission reduction equipment vendors, NV Energy operating and engineering data, and internal CH2M HILL historical information.

The level of accuracy of the cost estimate can be broadly classified as American Association of Cost Engineers (AACE) Class V or “Order of Magnitude,” which can be categorized as +50 percent/-30 percent. There are several reasons for selecting this range of cost estimates

to be included in the BART analysis. They are primarily a result of the difficulty in receiving detailed and accurate information from equipment vendors based on limited available data provided to the vendors. Because of the active power industry marketplace, obtaining engineering and construction information is restricted due to vendor workload. Material and construction labor costs also change rapidly in today's active economy. However, this level of cost estimate precision is adequate for comparison of control technology alternatives. The accuracy of expected emissions may also be questionable, and is also attributable to the inability to gain timely and accurate vendor information. This is exemplified by the difficulty in obtaining background information, and the vendor time required to develop accurate emission projections for study purposes in comparison to their response to actual project request for proposals. Also, variance in expected emissions can be dependent upon the pollutant under consideration (i.e., particulate emissions can generally be more accurately predicted than NO<sub>x</sub> emissions). Therefore, when establishing emission limitations in permits, consideration of variability in cost and expected emissions information must be considered.

## Fuel Characteristics

From the Title V Operating Permit, the primary fuel burned at Fort Churchill 1 will be PNG. The secondary fuel source is blended fuel oil (blended fuel oil is defined as the blending of No. 6 residual oil and No. 2 distillate fuel oil), and a third fuel option is co-fired PNG and blended fuel oil. Only the 100 percent PNG and 100 percent fuel oil options will be examined, and no co-firing or blended fuel alternatives will be reviewed. The capability to exclusively burn No. 2 fuel oil does not currently exist, and capital expenditures would be required to allow this fuel option. This BART analysis has considered the higher nitrogen content and different combustion characteristics of fuel oil as compared to PNG used at Fort. Churchill 1. This BART analysis has evaluated the effect of these qualities on NO<sub>x</sub> formation and achievable emission rates.

The Nevada Public Utilities Commission has mandated that Fort Churchill Unit 1 maintain the capability to use both PNG and fuel oil. However, as a first step in the BART implementation plan, NV Energy has committed to use only low-sulfur No. 2 fuel oil. Thus, the listing of No. 6 fuel oil in the BART engineering analysis is for historical and comparison purposes only.

## Recommendations

### NO<sub>x</sub> Emission Control

LNB has been selected as the NO<sub>x</sub> reduction technology with a NV Energy BART Limit (NVEBL) of 0.28 lb/MMBtu averaged on an annual basis. There is significant uncertainty involved in obtaining vendor emission guarantees and associated equipment/construction costs at this stage of analysis when retrofitting older boiler units. Site specific engineering is required on a "unit by unit" basis to determine the most effective control technology.

## **SO<sub>2</sub> Emission Control**

The utilization of PNG and/or low-sulfur No. 2 fuel oil is BART for Fort Churchill 1 with an NVEBL of 0.05 lb/MMBtu averaged on a 24-hour basis. No additional SO<sub>2</sub> emission control is required. No. 6 fuel oil will no longer be burned at the facility.

## **PM<sub>10</sub> Emission Control**

The utilization of PNG and/or low-sulfur No. 2 fuel oil is BART for Fort Churchill 1 with an NVEBL of 0.03 lb/MMBtu averaged on a 3-hour basis. No additional PM<sub>10</sub> emission control is required. No. 6 fuel oil will no longer be burned at the facility.

## **Control Recommendation**

The BART selections include the utilization of new LNB with PNG and/or low-sulfur No. 2 fuel oil, and are supported by cost and visibility analyses.

## **BART Modeling Analysis**

CH2M HILL is using the CALPUFF modeling system to assess the visibility impacts of emissions from Fort Churchill 1 at Class I areas. The Class I areas potentially affected are located more than 50 kilometers, but less than 300 kilometers, from the Fort Churchill Plant.

The Class I areas include the following wilderness areas (WA) and National Parks (NP):

- Mokelumne WA
- Desolation WA
- Hoover WA
- Emigrant WA
- Yosemite NP
- Ansel Adams WA
- John Muir WA
- Kaiser WA
- Kings Canyon NP
- Caribou WA
- Lassen Volcanic NP
- South Warner WA
- Thousand Lakes WA
- Sequoia NP

Visibility impacts were determined for the 1) WRAP baseline, 2) the current Title V emission permit limits, and 3) the proposed NVEBL.

# Contents

---

Section	Page
<b>Executive Summary</b> .....	<b>ES-1</b>
Background .....	ES-1
BART Engineering Analysis .....	ES-1
Establishing Emission Reduction Levels from BART Analysis Results .....	ES-2
Fuel Characteristics .....	ES-3
Recommendations .....	ES-3
NO <sub>x</sub> Emission Control .....	ES-3
SO <sub>2</sub> Emission Control.....	ES-4
PM <sub>10</sub> Emission Control .....	ES-4
Control Recommendation .....	ES-4
BART Modeling Analysis.....	ES-4
<b>Contents</b> .....	<b>ii</b>
<b>Acronyms and Abbreviations</b> .....	<b>iv</b>
<b>1.0 Introduction</b> .....	<b>1-1</b>
<b>2.0 Present Unit Operation</b> .....	<b>2-1</b>
<b>3.0 BART Engineering Analysis</b> .....	<b>3-1</b>
3.1 Applicability.....	3-1
3.2 BART Process.....	3-1
3.2.1 BART NO <sub>x</sub> Analysis .....	3-3
3.2.2 BART SO <sub>2</sub> Analysis .....	3-11
3.2.3 BART PM <sub>10</sub> Analysis .....	3-13
3.3 Summary.....	3-16
<b>4.0 BART Modeling Analysis</b> .....	<b>4-1</b>
4.1 Introduction.....	4-1
4.2 Model Selection.....	4-1
4.3 CALMET Methodology .....	4-2
4.3.1 Dimensions of the Modeling Domain .....	4-2
4.3.2 CALMET Input Data.....	4-4
4.3.3 Validation of CALMET Wind Field.....	4-5
4.4 CALPUFF Methodology.....	4-5
4.4.1 CALPUFF Modeling.....	4-5
4.4.2 Receptor Grids and Coordinate Conversion .....	4-7
4.5 Visibility Post-processing .....	4-7
4.5.1 CALPOST .....	4-7
4.6 Results.....	4-8
4.6.1 WRAP Verification Runs Results .....	4-8
4.6.2 BART Modeling Analysis.....	4-10
<b>5.0 BART Analysis and Recommendations</b> .....	<b>5-1</b>
5.1 Recommended BART Controls .....	5-1
5.2 Dispersion Modeling Results.....	5-2
5.2.1 NO <sub>x</sub> Control Scenario Visibility Modeling .....	5-6

5.3	Recommendations .....	5-7
5.3.1	NO <sub>x</sub> Emission Control .....	5-7
5.3.2	SO <sub>2</sub> Emission Control.....	5-7
5.3.3	PM <sub>10</sub> Emission Control.....	5-7
5.4	Just-Noticeable Differences in Atmospheric Haze .....	5-7
6.0	<b>References .....</b>	<b>6-1</b>

**Appendices**

- A Economic Analysis
- B BART Protocol

# Acronyms and Abbreviations

---

BACT	Best Available Control Technology
BAQP	Bureau of Air Quality Planning
BART	Best Available Retrofit Technology
Btu	British thermal unit
CALDESK	Program to display data and results
CALMET	Meteorological data preprocessing program for CALPUFF
CALPOST	Post-processing program for calculating visibility impacts
CALPUFF	Gaussian puff dispersion model
CFR	Code of Federal Regulations
COHPAC	Compact Hybrid Particulate Collector
dV	deciview
EPA	United States Environmental Protection Agency
ESP	electrostatic precipitator
$f$ (RH)	relative humidity factors
FD	forced draft
FGC	flue gas conditioning
FGD	flue gas desulfurization
FGR	flue gas recirculation
Fuel NO <sub>x</sub>	oxidation of fuel bound nitrogen
H <sub>2</sub> S	hydrogen sulfide
hp	horsepower
ID	internal diameter
IFGR	induced flue gas recirculation
kW	kilowatts
kW-Hr	kilowatt-hour
LAER	lowest achievable emission rate
lb/MMBtu	pounds per million British Thermal Units
LNB	low-NO <sub>x</sub> burner
LOI	loss on ignition
MM5	Mesoscale Meteorological Model, Version 5
MMBtu	Million British Thermal Units
MW	megawatts

N <sub>2</sub>	nitrogen
NDEP	Nevada Department of Environmental Protection
NO	nitric oxide
NO <sub>x</sub>	oxides of nitrogen
NP	National Park
NVE	NV Energy
NWS	National Weather Service
OFA	over-fire air
PM <sub>10</sub>	particulate matter less than 10 microns in aerodynamic diameter
PNG	Pipeline Quality Natural Gas
Ppm	part per million
RACT	Reasonably Achievable Control Technology
RBLC	RACT/BACT/LAER Clearinghouse
ROFA	Rotating Opposed Fire Air
NVEBL	NV Energy BART Limit
scf	standard cubic foot
SCR	selective catalytic reduction system
SDA	spray dryer absorber
SIP	State Implementation Plan
SNCR	selective non-catalytic reduction system
SO <sub>2</sub>	sulfur dioxide
SO <sub>3</sub>	sulfur trioxide
Thermal NO <sub>x</sub>	high temperature fixation of atmospheric nitrogen in combustion air
USGS	U.S. Geological Survey
WA	Wilderness Area
ΔdV	delta deciview, change in deciview

# 1.0 Introduction

---

Best Available Retrofit Technology (BART) guidelines were established as a result of United States Environmental Protection Agency (EPA) regulations intended to reduce the occurrence of regional haze in national parks and other Class I protected air quality areas in the United States<sup>1</sup>. These guidelines provide guidance for states when determining which facilities must install additional controls, and the type of controls that must be used. Facilities eligible for BART installation were built between 1962 and 1977, and have the potential to emit more than 250 tons/year of visibility-impairing pollutants.

The State of Nevada has identified those eligible in-state facilities that are required to reduce emissions under BART and will set BART emissions limits for those facilities. This information will be included in the State of Nevada State Implementation Plan (SIP), which the State has estimated will be formally submitted to the EPA by December 1, 2008. The EPA BART guidelines also state that the BART emission limits must be fully implemented within 5 years of EPA's approval of the SIP.

There are five basic elements related to BART when addressing the issue of emissions for the identified facilities:

- Any existing pollution control technology in use at the source
- The cost of the controls
- The remaining useful life of the source
- The energy and non-air environmental impacts of compliance
- The degree of improvement in visibility which may reasonably be anticipated from the use of such technology

This report documents the BART analysis that was performed on Fort Churchill 1 by CH2M HILL for NV Energy. The analysis was performed for nitrogen oxides (NO<sub>x</sub>), sulfur dioxide (SO<sub>2</sub>), and particulate matter less than 10 microns in aerodynamic diameter (PM<sub>10</sub>), because they are the primary criteria pollutants that affect visibility for unit operation while burning both natural gas and fuel oil.

Section 2.0 of this report provides a description of the present unit operation, including a discussion of fuel sources and analysis. The BART Engineering Analysis is provided in Section 3.0, by pollutant type. Section 4.0 provides the BART modeling methodology and Section 5.0 discusses the BART analysis and recommendations. References are provided in Section 6.0. Appendices A and B provide supporting information on the Economic Analysis and BART modeling protocol.

---

<sup>1</sup> 40 CFR Part 51: Regional Haze Regulations and Guidelines for Best Available Retrofit Technology (BART) Determinations; Final Rule. 70 Federal Register, 39103-39172, July 6, 2005.

## 2.0 Present Unit Operation

---

Fort Churchill 1 is a nominal 113 megawatts (MW) unit located approximately 12 miles north of Yerington in Lyon County, Nevada. The unit is equipped with a front wall-fired boiler manufactured by Babcock and Wilcox. Per the Title V Operating Permit, the unit can currently be fired using 1) pipeline quality natural gas (PNG), 2) blended fuel oil (blended fuel oil is defined as the blending of No. 6 residual oil and No. 2 distillate fuel oil), or 3) co-fired PNG and blended fuel oil.

Fort Churchill 1 began operation in 1968. This analysis is based on a 23-year life for BART control technologies. Assuming a BART implementation date of 2015, this will result in an approximate remaining useful life for Fort Churchill 1 of 23 years from the installation date of any BART-related equipment. This report does not attempt to quantify any additional life extension costs needed to allow the unit at Fort Churchill 1 to operate until 2038.

Determining current operating NO<sub>x</sub> levels before any potential emissions control equipment installation is difficult, especially because higher NO<sub>x</sub> emissions can be expected at higher unit operating loads. Therefore, PNG current NO<sub>x</sub> level is approximated by averaging the highest 75 percent load 24-hour NO<sub>x</sub> emission levels for the year 2006 EPA Acid Rain Database. As a simplifying assumption, No. 2 fuel oil NO<sub>x</sub> emissions are assumed to be equal to PNG. The No. 6 fuel oil NO<sub>x</sub> emissions were estimated by averaging the 24-hour NO<sub>x</sub> values for the year 2001 EPA Acid Rain Database. Fort Churchill Unit 1 burned No. 6 fuel oil for a few months during the Western energy crisis in 2001. The SO<sub>2</sub> emissions were also estimated from the EPA Acid Rain Database. PM<sub>10</sub> values were determined either by test results or AP-42 calculations.

The BART regulations state that the baseline emissions utilized for visibility modeling be established by identifying the highest 24-hour average actual emission rate from the period modeled for the pre-control scenario. Modeling would then consider the expected emissions rate after the installation of BART controls to establish the level of visibility improvement.

For the pre-control scenario, modeling was conducted at the WRAP 24-hour maximum values and at the Title V permit limits for the unit. The post-control scenario was modeled at the proposed NV Energy BART Limits (discussed in Sections 3, 4, and 5), with the exception of the NO<sub>x</sub> emission rate which is higher than the NVEBL.

Table 2-1 lists unit information and emission rates for this analysis.

**TABLE 2-1**  
Unit Operation and Study Assumptions  
Fort Churchill Unit 1

<b>General Plant Data</b>	
Site Elevation (feet above MSL)	4,308
Stack Height (feet)	162
Stack Exit ID (feet) /Exit Area (sq. ft.)	11.2 /98.5
Stack Exit Temperature (°F)	268
Stack Exit Velocity (ft/sec)	69.9
Stack Flow (ACFM)	413,914
Annual Unit Capacity Factor (%)	51
Net Unit Output (Nominal MW)	113
Net Unit Heat Rate (Btu/kW-Hr)(100% load)	10,683
Boiler Heat Input (MMBtu/Hr)(100% load)	1,319.8
Type of Boiler	Front Wall fired
Boiler Fuel	PNG, Blended Fuel Oil
<b>NO<sub>x</sub> Emissions Data (24-hour Average Maximum)</b>	
Current NO <sub>x</sub> Controls	None: Good combustion practices
Title V NO <sub>x</sub> Permit Limit (lb/MMBtu)	0.8
WRAP NO <sub>x</sub> Emission Rate (lb/MMBtu)	0.434
NO <sub>x</sub> Emission Rate (lb/MMBtu) (PNG) <sup>c</sup>	0.404
NO <sub>x</sub> Emission Rate (lb/MMBtu) (No.6 Fuel Oil) <sup>a</sup>	0.554
NO <sub>x</sub> Emission Rate (lb/MMBtu) (No.2 Fuel Oil) <sup>c</sup>	0.404
<b>SO<sub>2</sub> Emissions Data (24-hour Average Maximum)</b>	
Current SO <sub>2</sub> Controls	None
Title V SO <sub>2</sub> Permit Limit (lb/MMBtu) (3-hr average)	0.8
WRAP SO <sub>2</sub> Emission Rate (lb/MMBtu)	0.582
SO <sub>2</sub> Emission Rate (lb/MMBtu) (PNG) <sup>c</sup>	0.0006
SO <sub>2</sub> Emission Rate (lb/MMBtu) (No.6 Fuel Oil) <sup>a</sup>	0.370
SO <sub>2</sub> Emission Rate (lb/MMBtu) (No.2 Fuel Oil) <sup>b</sup>	0.051
<b>PM<sub>10</sub> Emissions Data (24-hour Average Maximum)</b>	
Current PM <sub>10</sub> Controls	None
Title V PM <sub>10</sub> Permit Limit (lb/MMBtu) (1-hr average)	0.194
WRAP PM <sub>10</sub> Emission Rate (lb/MMBtu)	0.019
PM <sub>10</sub> Emission Rate (lb/MMBtu) (PNG) <sup>a</sup>	0.001
PM <sub>10</sub> Emission Rate (lb/MMBtu) (No.6 Fuel Oil) <sup>a</sup>	0.028
PM <sub>10</sub> Emission Rate (lb/MMBtu) (No.2 Fuel Oil) <sup>b</sup>	0.014

<sup>a</sup> - Highest 24-hr averages from 2001 CEM data/emissions test data.

<sup>b</sup> - Calculated from EPA AP-42 Table 1.3-1 assuming No. 2 fuel oil sulfur content of 0.05 percent and heating value of 140,000 Btu/gal

<sup>c</sup> - Highest 24-hr averages from

<sup>d</sup> - Calculated from EPA AP-42 Table 1-4.2

EPA did not establish a NO<sub>x</sub> presumptive limit for oil and gas-fired units, but indicates that the states should consider the installation of combustion control technology on these units. Similarly, EPA also did not establish a presumptive BART limit for SO<sub>2</sub> from gas and oil-fired units. The EPA guidelines suggest that a cost-effective SO<sub>2</sub> control option for oil-fired units is to consider switching to a low-sulfur fuel oil (No.2 fuel oil – 0.05 percent low sulfur diesel). EPA also stated that it was unable to find a flue gas desulfurization (FGD) application in the U.S. electric industry on an oil-fired unit.

According to 40 Code of Federal Regulations (CFR) Parts 72 & 75, in order for a gaseous fuel to qualify as “natural gas,” the fuel must be either greater than or equal to 70 percent methane by volume, or must have a gross calorific value between 950 and 1,100 Btu/standard cubic foot (scf). For PNG, the hydrogen sulfide (H<sub>2</sub>S) content must be less than or equal to 0.3 grain/100 scf, and H<sub>2</sub>S must constitute at least 50 percent (by weight) of the total sulfur in the fuel.

No fuel specification was provided for No. 2 fuel oil, therefore a heating value of 140,000 Btu/gal and a sulfur limit of 0.05 percent were assumed.

Specification values for No. 6 fuel oil are listed below:

- 6.1 to 6.45 million British thermal units (MMBtu)/barrel heating value
- 0.39 lb of sulfur/MMBtu
- Less than 0.1 percent ash by weight
- Less than 50 parts per million (ppm) vanadium
- Less than 50 ppm sodium
- Less than 9.7 percent carbon residue by weight

The BART analysis for Fort Churchill Unit 1 includes a review of PNG, No. 2 fuel oil, and No. 6 fuel oil operation. The WRAP baseline modeling included 2001 operation when No. 6 fuel oil was burned. Therefore, this fuel option is shown in the analysis.

The Nevada Public Utilities Commission has mandated that Fort Churchill Unit 1 maintain the capability to use both PNG and fuel oil. However, as a first step in the BART implementation plan, NV Energy has committed to use only low-sulfur No. 2 fuel oil. Thus, the listing of No. 6 fuel oil in the BART engineering analysis is for historical and comparison purposes only.

## 3.0 BART Engineering Analysis

---

This section presents the required BART engineering analysis.

### 3.1 Applicability

In compliance with regional haze requirements, the State of Nevada must prepare and submit visibility SIPs to the EPA for Class I areas. The State has estimated that the formal submittal of the SIPs to EPA will occur by December 1, 2008. The first phase of the regional haze program is the implementation of BART emission controls on all BART eligible units, within 5 years after EPA approval of the SIP.

### 3.2 BART Process

The specific steps in a BART engineering analysis are identified in 40 CFR 51 Appendix Y, Section IV. The evaluation must include the following:

1. The identification of available, technically feasible, retrofit control options
2. Consideration of any pollution control equipment in use at the source (which affects the availability of options and their impacts)
3. The costs of compliance with the control options
4. The remaining useful life of the facility
5. The energy and non-air quality environmental impacts of compliance
6. The degree of visibility improvement that may reasonably be anticipated from the use of BART.

These steps are incorporated into the BART analysis as follows:

#### **Step 1 - Identify All Available Retrofit Control Technologies**

#### **Step 2 - Eliminate Technically Infeasible Options**

- The identification of available, technically feasible, retrofit control options
- Consideration of any pollution control equipment in use at the source (which affects the applicability of options and their impacts)

#### **Step 3 - Evaluate Control Effectiveness of Remaining Control Technologies**

- Costs associated with control technologies are summarized in the economic analysis presented in Appendix A. For clarity, Appendix A also includes sample economic analysis spreadsheet calculations and explanation of assumptions used.

#### Step 4 – Evaluate Energy and Non-Air Quality Impacts

- The costs of compliance with the control options
- The remaining useful life of the facility
- The energy and non-air quality environmental impacts of compliance

#### Step 5 – Evaluate Visibility Impacts

- The degree of visibility improvement that may reasonably be anticipated from BART use.

In order to minimize costs in the BART analysis, consideration was made of any pollution control equipment in use at the source, the costs of compliance associated with the control options, and the energy and non-air quality environmental impacts of compliance using these existing control devices. In some cases, enhancing the performance of the existing control equipment was considered. Other scenarios with new control equipment were also developed.

Separate analyses have been conducted for NO<sub>x</sub>, SO<sub>2</sub>, and PM<sub>10</sub> emissions. Because Fort Churchill 1 currently has the option to burn PNG, No. 2 fuel oil, or No. 6 fuel oil, a separate analysis will be completed for each case. The option to switch to low-sulfur fuel oil (No. 2) will be examined, as required by the BART regulations.

For Fort Churchill 1, baseline NO<sub>x</sub>, SO<sub>2</sub>, PM<sub>10</sub> emissions were examined to determine whether completion of the five-step BART process is required for each of the three fuel alternatives (100 percent PNG, 100 percent No. 6 fuel oil, and 100 percent No. 2 fuel oil). Table 3-1 below is a summary of the baseline emissions for Fort Churchill 1.

**TABLE 3-1**  
Current Fort Churchill Unit 1 Baseline Emissions

<b>Baseline Emissions (lb/MMBtu)</b>	<b>PNG</b>	<b>No. 6 Fuel Oil</b>	<b>No. 2 Fuel Oil</b>
NO <sub>x</sub>	0.404	0.554	0.404
SO <sub>2</sub>	0.0006	0.370	0.051
PM <sub>10</sub>	0.001	0.028	0.014

A BART NO<sub>x</sub> analysis was completed for all fuels. An SO<sub>2</sub> analysis and a PM<sub>10</sub> analysis for No. 6 fuel oil was completed for comparison purposes (as stated in Section 2 of this report, NV Energy has made a commitment to only use low-sulfur No. 2 fuel oil). The baseline PM<sub>10</sub> and SO<sub>2</sub> emissions when burning No. 2 fuel oil is considered BART, based on EPA BART guidelines.

All costs included in the BART analysis are in 2007 dollars, and costs have not been escalated to the assumed 2015 BART implementation date.

## Establishing Permit Emission Reduction Levels from BART Analysis Results

As an integral part of the BART analysis process, cost and expected emission information was developed for NO<sub>x</sub>, SO<sub>2</sub>, and PM<sub>10</sub>. This information is assembled from various sources including emission reduction equipment vendors, NV Energy operating and engineering data, and internal CH2M HILL historical information.

The level of accuracy of the cost estimate can be broadly classified as “Order of Magnitude,” which can be categorized as -30/+50 percent. There are several reasons for the wide range of cost estimates included in the BART analysis, however are primarily caused by the difficulty in receiving detailed and accurate information from equipment vendors. Due to the extremely active power industry marketplace, obtaining engineering and construction is severely restricted due to vendor workload. Material and construction labor costs are also widely fluctuating in today’s active economy.

The accuracy of expected emissions may also be questionable and is also attributable to the inability to gain timely and accurate information. This is exemplified by the difficulty in obtaining background information, and the vendor time required to develop accurate emission projections for study purposes as opposed to their response to actual project request for proposals. Variance in expected emissions can be dependent upon the pollutant under consideration (i.e., particulate emissions can generally be more accurately predicted than NO<sub>x</sub> emissions).

Therefore, when selecting emissions control technologies and establishing emission permitting levels, consideration of variability in cost and expected emissions information must be considered.

### 3.2.1 BART NO<sub>x</sub> Analysis

NO<sub>x</sub> formation in fuel-fired boilers is a complex process that is dependent on a number of variables, including operating conditions, equipment design, and fuel characteristics. A NO<sub>x</sub> BART analysis will be completed for the cases when Fort Churchill 1 burns 100 percent PNG, 100 percent No. 6 fuel oil, and 100 percent No. 2 fuel oil.

#### 3.2.1.1 Formation of NO<sub>x</sub>

During combustion, NO<sub>x</sub> is formed in three different ways: thermal NO<sub>x</sub>, fuel NO<sub>x</sub>, and prompt NO<sub>x</sub>. When combusting PNG, the most dominant source of NO<sub>x</sub> is from thermal NO<sub>x</sub>, which is due to high-temperature fixation of atmospheric nitrogen in the combustion air. Because PNG generally contains small quantities of nitrogen, the overall contribution from fuel NO<sub>x</sub> is small, while a substantial amount of fuel NO<sub>x</sub> can be generated from fuel oil combustion. A very small amount of NO<sub>x</sub> is called “prompt” NO<sub>x</sub>. Prompt NO<sub>x</sub> results from an interaction of hydrocarbon radicals, nitrogen, and oxygen.

Good combustion is based on the “three Ts”: time, temperature and turbulence. If a performance requirement such as NO<sub>x</sub> emission limits is changed, conflicts with other performance issues can result.

When adjusting air flows and distribution to lower NO<sub>x</sub> using low NO<sub>x</sub> burners (LNB), original boiler design restrictions may limit the changes that can be made and still achieve satisfactory combustion performance.

### 3.2.1.2 Step 1: Identify All Available Retrofit Control Technologies

The first step of the BART process is to evaluate NO<sub>x</sub> control technologies with practical potential for application to Fort Churchill 1, including those control technologies identified as BACT by permitting agencies across the United States. A broad range of information sources have been reviewed in an effort to identify potentially applicable and demonstrated in practice emission control technologies. Fort Churchill 1 NO<sub>x</sub> emissions are currently controlled through the use of good combustion practices. There is no BART presumptive NO<sub>x</sub> level for PNG and oil-fired units.

The following potential NO<sub>x</sub> control technology options were considered:

- Low NO<sub>x</sub> Burners (LNB)
- Low NO<sub>x</sub> Burners (LNB) with Flue Gas Recirculation (FGR)
- Low NO<sub>x</sub> Burners (LNB) with Selective non-catalytic reduction system (SNCR)
- Rotating Opposed Fire Air (ROFA) with Rotamix
- LNB with selective catalytic reduction system (SCR)

### 3.2.1.3 Step 2: Eliminate Technically Infeasible Options

For Fort Churchill 1, a front wall-fired configuration burning PNG and fuel oil, technical feasibility will primarily be determined by physical constraints, boiler configuration, and on the ability of the technology to achieve substantial NO<sub>x</sub> emissions reduction. Current NO<sub>x</sub> emissions for Fort Churchill 1 are shown in Table 3-1 while burning PNG, No. 6 fuel oil, and No. 2 fuel oil.

For this BART analysis, information received from Coen was used as the basis for new LNB and LNB w/FGR. Coen did not propose the installation of OFA due to the cost of boiler water wall changes. The cost estimates for SCR and SNCR were updated from previous CH2M HILL file information and Fuel Tech budgetary proposal, respectively. Also, CH2M HILL received a proposal from Mobotec for their ROFA and Rotomix technologies.

Table 3-2 summarizes the control technology options evaluated in this BART analysis, along with projected NO<sub>x</sub> emission rates. It should be noted that estimated emissions information from NO<sub>x</sub> technologies presented represent design targets. With a significant potential for variability in emissions due to changes in unit operation, a longer averaging period results in a higher probability in meeting the permit emissions value. Emissions based on a 24-hour averaging period are not directly comparable to emissions targets based on a longer averaging time.

**TABLE 3-2**  
**NO<sub>x</sub> Control Technology Emission Rate Ranking**  
*Fort Churchill Unit 1*

<b>Technology</b>	<b>Source of Estimated Emissions</b>	<b>Estimated Emission Rate (lb/MMBtu (PNG))</b>	<b>Estimated Emission Rate (lb/MMBtu) (No.6 Fuel Oil)</b>	<b>Estimated Emission Rate (lb/MMBtu) (No.2 Fuel Oil)</b>
Current Permit Limits (converted to lb/MMBtu for comparison)	Title V	0.8	0.8	0.8
NV Energy (NVE) BART Limits	NVEBL <sup>d</sup>	0.28 (Annual)	N/A	0.28 (Annual)
LNB	Coen	0.26	0.28	0.22
LNB w/FGR	Coen	0.12	0.24	0.14
LNB w/ SNCR	Coen & Fuel Tech	0.20 <sup>c</sup>	0.21 <sup>c</sup>	0.17 <sup>c</sup>
ROFA w/Rotamix	Mobotec	0.15	0.19	0.15 <sup>b</sup>
LNB w/ SCR <sup>a</sup>	CH2M HILL	0.07	0.07	0.07

<sup>a</sup> SCR estimated NO<sub>x</sub> emissions rate is the same for all scenarios. Operating cost would be affected by inlet NO<sub>x</sub> levels.

<sup>b</sup> Calculated from Mobotec proposal information and No.2 fuel oil baseline NO<sub>x</sub>

<sup>c</sup> Assumed 25 percent from a reduced LNB baseline

<sup>d</sup> NVEBL – Based on Coen information for LNB and FGR.

### 3.2.1.4 Step 3: Evaluate Control Effectiveness of Remaining Control Technologies

Preliminary vendor proposals, such as those used to support portions of this BART analysis, may be technically feasible and provide expected emission rates; however, they include inherent uncertainties. These proposals are usually prepared in a limited time frame, may be based on incomplete information, may contain overly optimistic conclusions, and are non-binding. Therefore, emission rate values obtained in such preliminary proposals must be qualified, and it must be recognized that contractual guarantees are established only after more detailed analysis has been completed. Also, emission rates are typically based on a design average value (i.e., 30-day rolling average) versus a maximum 24-hour value. The following subsections describe the control technologies and the control effectiveness evaluated in this BART analysis.

**Level of Confidence for Vendor Post-Control Emissions Estimates.** In order to determine the level of NO<sub>x</sub> emissions needed to achieve compliance consistently with an established goal, a review of typical NO<sub>x</sub> emissions from generating units was completed. As a result of this review, it was noted that NO<sub>x</sub> emissions can vary around an average emissions level. This variance can be attributed to many reasons, including fuel characteristics, unit load, boiler operation including excess air, burner equipment condition, and so forth.

The steps utilized for determining a level of confidence for the vendor expected value are as follows:

1. Establish expected NO<sub>x</sub> emissions value from vendor.

2. Evaluate vendor experience and historical basis for meeting expected values.
3. Review and evaluate unit physical and operational characteristics and restrictions. The fewer variations there are in operations, fuel supply, etc., the more predictable and less variant the NO<sub>x</sub> emissions are.
4. For each technology expected value, there is a corresponding potential for actual NO<sub>x</sub> emissions to vary from this expected value. From the vendor information presented, along with anticipated unit operational data, an adjustment to the expected value can be made.

The following subsections describe the control technologies and the control effectiveness evaluated in this NO<sub>x</sub> BART analysis.

**New LNB.** The mechanism used to lower NO<sub>x</sub> with LNB is to stage the combustion process and provide a fuel-rich condition initially; this is so oxygen needed for combustion is not diverted to combine with nitrogen and form NO<sub>x</sub>. Fuel-rich conditions favor the conversion of fuel nitrogen to N<sub>2</sub> instead of NO<sub>x</sub>. LNB are considered to be a capital cost, combustion technology retrofit which may require water wall tube replacement.

**FGR.** Flue Gas Recirculation (FGR) generally extracts flue gas from downstream of the economizer or air heater and is mixed into the combustion air duct. This recirculation can be achieved with a new FGR fan, or by using the existing Forced Draft (FD) fan to inject the flue gas into the combustion air (induced flue gas recirculation). FGR adds oxygen-lean heat-absorbing mass to the combustion air, thus lowering the combustion temperature and reducing NO<sub>x</sub> emissions.

**Neural Net Controls.** Information regarding neural net controls was received from NeuCo, Inc. While NeuCo offers several neural net products, CombustionOpt and SootOpt provide the potential for NO<sub>x</sub> reduction. NeuCo stated these products can be utilized on most control systems, and can be effective even in conjunction with other NO<sub>x</sub> reduction technologies. NeuCo predicts that CombustionOpt can reduce NO<sub>x</sub> by 15 percent, and SootOpt can provide an additional 5 to 10 percent. Because NeuCo does not offer guarantees on this projected emission reduction, a nominal reduction of 15 percent was assumed for evaluation purposes. The budgetary price for CombustionOpt and SootOpt were \$150,000 and \$175,000, respectively, with an additional \$200,000 for a process link to the unit control system. Because NeuCo does not guarantee NO<sub>x</sub> reduction, the estimated emission reduction levels provided can not be considered as reliable projections. Therefore, neural net should be considered as a supplementary or “polishing” technology, but not on a “stand-alone” basis.

**ROFA.** Mobotec markets ROFA as an improved second generation OFA system. Mobotec states that “the flue gas volume of the furnace is set in rotation by asymmetrically placed air nozzles. Rotation is reported to prevent laminar flow, so that the entire volume of the furnace can be used more effectively for the combustion process. In addition, the swirling action reduces the maximum temperature of the flames and increases heat absorption. The combustion air is also mixed more effectively”. A typical ROFA installation will have a booster fan(s) to supply the high-velocity air to the ROFA boxes, and Mobotec would propose one 420 horsepower (hp) fan for Fort Churchill 1.

Mobotec's budgetary proposals included expected NO<sub>x</sub> emission rates for PNG and No. 2 and No. 6 fuel oils, and are presented in Table 3-2 above. While a typical installation does not require changes to the existing LNB system, results of computational fluid dynamics modeling will determine the quantity and location of new ROFA ports. Although not specifically identified, Mobotec generally includes bent tube assemblies for ROFA port installation if required. Mobotec does not provide installation services, because they believe that the owner can more cost effectively contract for these services. However, they do provide one onsite construction supervisor during installation and startup.

Due to previous experience with ROFA, NVE does not consider ROFA as a stand-alone technology option.

**ROFA with Rotamix.** As described above, ROFA is marketed as an improved OFA system. Rotamix is Mobotec's technology for adding selective non-catalytic reduction using an ammonia or urea based reagent.

**SNCR.** Selective non-catalytic reduction is generally utilized to achieve modest NO<sub>x</sub> reductions on smaller units. With SNCR, an amine-based reagent such as ammonia – or more commonly urea – is injected into the furnace within a temperature range of 1,600°F to 2,100°F, where it reduces NO<sub>x</sub> to nitrogen and water. NO<sub>x</sub> reductions of up to 60 percent have been achieved, although 20 to 40 percent is more realistic for most applications.

Reagent utilization, which is a measure of the efficiency with which the reagent reduces NO<sub>x</sub>, can range from 20 to 60 percent, depending on the amount of reduction, unit size, operating conditions, and allowable ammonia slip. With low-reagent utilization, low temperatures, or inadequate mixing, ammonia slip occurs, allowing unreacted ammonia to create problems downstream. The ammonia may react with sulfur to foul heat exchange surfaces, and/or create a visible stack plume. Reagent utilization can have an impact on economics, with higher levels of NO<sub>x</sub> reduction generally resulting in lower reagent utilization and higher operating cost.

Reductions from higher baseline concentrations (inlet NO<sub>x</sub>) are lower in cost per ton, but result in higher operating costs, due to greater reagent consumption. A budgetary proposal was received from Fuel Tech.

**SCR.** SCR works on the same chemical principle as SNCR, but SCR uses a catalyst to promote the chemical reaction. Ammonia is injected into the flue-gas stream, where it reduces NO<sub>x</sub> to nitrogen and water. Unlike the high temperatures required for SNCR, in SCR the reaction takes place on the surface of a vanadium/titanium-based catalyst at a temperature range between 580° F and 750° F. Due to the catalyst, the SCR process is more efficient than SNCR and results in lower NO<sub>x</sub> emissions. The most common type of SCR is the high-dust configuration, where the catalyst is located downstream from the boiler economizer and upstream of the air heater and any particulate control equipment. In this location, the SCR is exposed to the full concentration of any particulate in the flue gas that is leaving the boiler. In a full-scale SCR, the flue ducts are routed to a separate large reactor containing the catalyst. With in-duct SCR, the catalyst is located in the existing gas duct, which may be expanded in the area of the catalyst to reduce flue gas flow velocity and increase flue gas residence time. Due to the higher removal rate, a full-scale SCR was used as the basis for analysis at Fort Churchill 1. From previous SCR design experience, a

projected NO<sub>x</sub> emission rate of 0.07 lb/MMBtu is projected for all emissions control equipment scenarios assuming current equipment can meet retrofit requirements.

#### 3.2.1.5 Step 4: Evaluate Impacts and Document the Results

This step involves the consideration of energy, environmental, and economic impacts associated with each control technology. The remaining useful life of the plant is also considered during the evaluation.

**Energy Impacts.** The installation of LNB are not expected to impact the boiler efficiency or forced draft fan power usage substantially. Therefore, these technologies will not have energy impacts.

The Mobotec ROFA system requires installation and operation of one 420 hp ROFA fan (313 kilowatt [kW] total). Fuel Tech provided an estimated auxiliary power requirement of 116 kW, and the same estimate was used for Rotamix.

SCR retrofit impacts the existing flue gas fan systems, due to the additional pressure drop associated with the catalyst, which is typically a 6- to 8-inch water gage increase.

The energy impacts summarized above are included in the economic analysis presented in Appendix A.

**Environmental Impacts.** SNCR, Rotamix and SCR installation could potentially create a visible stack plume, which may negate other visibility improvements. Other environmental impacts involve the storage of ammonia, especially if anhydrous ammonia is used, and the transportation of the ammonia to the power plant site.

These environmental impacts have not been quantified in the economic analysis presented in Appendix A.

**Economic Impacts.** Costs and emissions estimates for the LNB, LNB w/FGR, SNCR, and SCR were obtained from equipment vendors. Costs for the ROFA and Rotamix systems were obtained from Mobotec.

A comparison of the technologies on the basis of costs, design control efficiencies, and tons of NO<sub>x</sub> removed is summarized in Table 3-3, and the first year control costs are shown in Figure 3-1.

The capital costs shown in Table 3-3 are applicable for all of the fuels under consideration. For example, if LNB are installed for PNG, the burner costs include the capability to burn both PNG and No. 2 and 6 fuel oils (with only minor equipment changes, atomization changes, and burner control revisions). Similarly, the cost information for any of the NO<sub>x</sub> reduction technologies listed in Table 3-3 will apply for the fuel alternatives under consideration.

The complete Economic Analysis is contained in Appendix A.

#### 3.2.1.6 Step 5: Evaluate Visibility Impacts

Please see Section 4.0, BART Modeling Analysis.


**TABLE 3-3**  
 NO<sub>x</sub> Control Cost Comparison using Fuel Oil #6  
 Fort Churchill Unit 1

<b>Factor</b>	<b>LNB</b>	<b>LNB w/ FGR</b>	<b>LNB w/SNCR</b>	<b>ROFA w/Rotamix</b>	<b>LNB w/SCR</b>
Total Installed Capital Costs	\$600,000	\$920,000	\$2,523,750 <sup>b</sup>	\$5,250,940 <sup>a</sup>	\$28,625,000
Total Installed Capital Costs with Additional Owner Costs	\$1,050,000	\$1,610,000	\$4,416,563	\$9,189,145	\$35,781,250
Total First Year Fixed & Variable O&M Costs	\$45,200	\$320,219	\$424,800	\$695,193	\$705,037
Total First Year Annualized Cost	\$156,559	\$490,970	\$893,203	\$1,669,757	\$4,499,854
Power Consumption (MW)	-	1.13	0.11	1.24	0.57
Annual Power Usage (Million kW-Hr/Yr)	-	5.0	0.5	5.6	2.5
NO <sub>x</sub> Design Control Efficiency	49.5%	56.7%	62.1%	65.7%	87.4%
Tons NO <sub>x</sub> Removed per Year	739	847	928	982	1,305
First Year Ave Control Cost (\$/Ton NO <sub>x</sub> Removed)	212	580	963	1,701	3,448
Incremental Control Cost (\$/Ton NO <sub>x</sub> Removed)	212	3,100	4,972	14,399	8,746

<sup>a</sup> Based on 75/25 installation cost split between ROFA and Rotamix

<sup>b</sup> Fuel Tech equipment estimate plus 50 percent installation cost

**FIGURE 3-1**  
First Year Control Cost for NO<sub>x</sub> Air Pollution Control Options  
Fort Churchill Unit 1

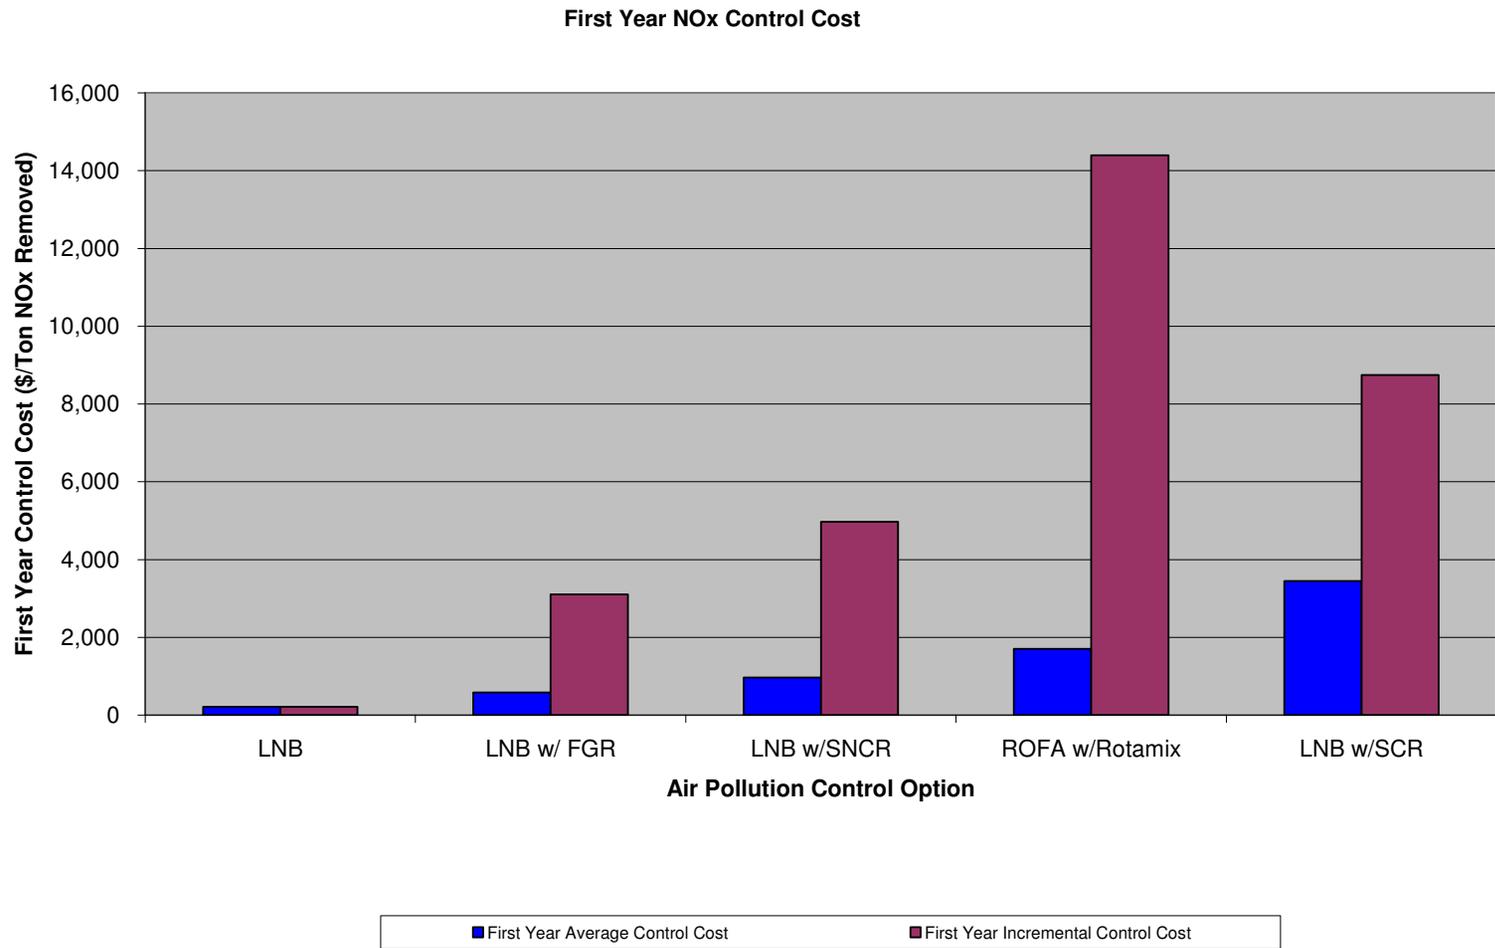

### 3.2.2 BART SO<sub>2</sub> Analysis

SO<sub>2</sub> forms in the boiler during the combustion process and is primarily dependent on natural gas and fuel oil sulfur content. The BART analysis for SO<sub>2</sub> emissions on Fort Churchill 1 is described below. The analysis completed in Section 3.2 is for the case when burning No. 6 fuel oil.

BART guidelines require that oil-fired units consider limiting the sulfur content of the fuel oil burned. Because current requirements for low sulfur diesel fuel limits sulfur content to 0.05 percent, fuel switching will be analyzed as an SO<sub>2</sub> option for this study. Also, a flue gas desulfurization system (spray dryer absorber) with similar SO<sub>2</sub> reduction capability as the fuel switch option will be considered. It should be noted that the Nevada Public Utilities Commission has mandated that the Fort Churchill units have both PNG and fuel oil capability.

#### 3.2.2.1 Step 1: Identify All Available Retrofit Control Technologies

A broad range of information sources was reviewed in an effort to identify potentially applicable emission control technologies for SO<sub>2</sub> at Fort Churchill 1; this included control technologies identified as BACT by permitting agencies across the United States.

The following potential SO<sub>2</sub> control technology options were considered:

- Use of low sulfur distillate oil (No. 2 fuel oil)
- Spray Dryer Absorber (SDA)

#### 3.2.2.2 Step 2: Eliminate Technically Infeasible Options

Technical feasibility will primarily be determined by fuel storage delivery constraints, boiler configuration, and on the ability of low sulfur fuel oil to achieve substantial SO<sub>2</sub> emissions reduction. Table 3-4 summarizes the control technology options evaluated in this BART analysis.

**TABLE 3-4**  
SO<sub>2</sub> Control Technology Emission Rates  
Fort Churchill Fort Churchill Unit 1

Technology	Estimated SO <sub>2</sub> Removal Efficiency (%)	Estimated Emission Rate (lb/MMBtu)
Current Title V Permit Limitation (converted to lb/MMBtu for comparison)	N/A	0.8 (3-hr average)
NVE BART Limit (Low Sulfur No. 2 Fuel Oil)	93	0.05 (24-hr average)
Spray Dryer Absorber	90	0.10
PNG	99	0.004

### 3.2.2.3 Step 3: Evaluate Control Effectiveness of Remaining Control Technologies

When evaluating the control effectiveness of SO<sub>2</sub> reduction technologies, each option can be compared to the proposed NVE BART Limit. With a fuel switch to low sulfur diesel, the expected SO<sub>2</sub> emissions are estimated at this level. While an SDA is estimated to achieve up to an approximate 90 percent reduction in SO<sub>2</sub>, an expected emission of 0.10 lb/MMBtu is estimated with the lower inlet SO<sub>2</sub> level. Because Fort Churchill 1 is not currently capable of burning 100% No. 2 fuel oil, capital improvements would be required.

The following describe the control technologies and the control effectiveness evaluated in this BART analysis.

#### **Use of low sulfur distillate oil (No. 2 fuel oil)**

This alternative entails the use of a low sulfur (0.05 % sulfur) diesel in lieu of No. 6 fuel oil.

#### **Spray Dryer Absorber (SDA)**

A spray dryer absorber typically injects lime slurry in the top of the absorber vessel with a rapidly rotating atomizer wheel. The rapid speed of the atomizer wheel causes the lime slurry to separate into very fine droplets that intermix with the flue gas. The SO<sub>2</sub> in the flue gas reacts with the calcium in the lime slurry to form dry calcium sulfate particles. For Fort Churchill 1, this dry particulate matter would be captured downstream in a baghouse which would be required in conjunction with the SDA. A lime spray dryer system typically produces a dry waste product suitable for landfill disposal. Emissions from an SDA are estimated to meet an emissions level of 0.10 lb/MMBtu.

### 3.2.2.4 Step 4: Evaluate Impacts and Document the Results

This step involves the consideration of energy, environmental, and economic impacts associated with each control technology. The remaining useful life of the plant is also considered during the evaluation.

**Energy Impacts.** There is no energy impact associated with switching to low sulfur diesel fuel, however additional system pressure drop will result from an installation of an SDA.

No energy impact costs are included in the economic analysis presented in Appendix A.

**Environmental Impacts.** There is no environmental impact associated with switching to low sulfur diesel fuel or installation of an SDA.

No environmental impact costs have been quantified in the economic analysis presented in Appendix A.

**Economic Impacts.** A summary of the costs and amount of SO<sub>2</sub> removed for fuel switching is provided in Table 3-5.

**TABLE 3-5**  
SO<sub>2</sub> Control Cost  
Fort Churchill Unit 1

Factor	Spray Dryer Absorber	Switch to Low Sulfur Fuel <sup>a</sup>
Total Installed Capital Costs	\$22,000,000	\$500,000
Total First Year Fixed & Variable Operations and Maintenance Costs	\$513,975	-
Total First Year Annualized Cost	\$2,847,207	-
Power Consumption (MW)	0.40	-
Annual Power Usage (kW-Hr/Yr)	1.8	-
SO <sub>2</sub> Design Control Efficiency	84.8%	93%
Tons SO <sub>2</sub> Removed per Year	1,508	-
First Year Average Control Cost (\$/Ton of SO <sub>2</sub> Removed)	1,889	-
Incremental Control Cost (\$/Ton of SO <sub>2</sub> Removed)	1,889	-

<sup>a</sup> Per unit cost based on Zachry study for fuel switch to No. 2 fuel oil for Tracy Station. Does not include fuel cost differential.

The complete Economic Analysis is contained in Appendix A

### 3.2.2.5 Step 5: Evaluate Visibility Impacts

Please see Section 4.0, BART Modeling Analysis.

## 3.2.3 BART PM<sub>10</sub> Analysis

Fort Churchill 1 currently is not equipped with a PM<sub>10</sub> control device. The BART analysis for PM<sub>10</sub> emissions at Fort Churchill 1 is described below. From the analysis completed in Section 3.2, a PM<sub>10</sub> BART analysis will only be completed for the case when Fort Churchill 1 burns 100 percent No. 6 fuel oil. The current baseline PM<sub>10</sub> emissions, while burning PNG or No. 2 fuel oil, already meet the BACT emissions level.

### 3.2.3.1 Step 1: Identify All Available Retrofit Control Technologies

The following retrofit control technologies have been identified for additional PM<sub>10</sub> control:

- Use of low sulfur fuel oil (No. 2 fuel oil) and LNB
- Dry Electrostatic Precipitator
- Wet Electrostatic Precipitator
- Fabric filter

### 3.2.3.2 Step 2: Eliminate Technically Infeasible Options

**Low Sulfur Distillate Oil and LNB.** PM<sub>10</sub> emissions would be reduced with the switching of fuel oil grades from No. 6 to No. 2 and the utilization of LNB. PM<sub>10</sub> emissions while burning No. 2 fuel oil are estimated to meet the NVE BART Limit of 0.03 lb/MMBtu.

**Dry Electrostatic Precipitator.** A dry ESP operates by first placing a charge on the particles through a series of electrodes, and then capturing the charged particles on collection plates. While an ESP can be designed for high-particulate removal, operation is susceptible to particle resistivity, which denotes a collected particle's ability to discharge ultimately to the collection plate. Low-resistivity particles can be easily charged but may quickly lose their charge at the collection plate and tend to be re-entrained into the flue gas stream. Higher resistivity particles may form a "back corona," which is caused by a layer of non-conductive particles being formed on the collection plate. Back corona may prevent other charged gas stream particles from migrating to the collection plate. Particle resistivity is also influenced by flue gas temperature. ESP sizing is in large part determined by particulate size, with larger ESP size required when smaller particles are expected. In addition, the particles from an oil-fired unit tend to be small and sticky, and if an SDA is utilized for SO<sub>2</sub> reduction there will be a greatly increased inlet particulate loading to the ESP

Because of the uncertainty in chemical and physical characteristics of the oil-fired particulate, and the increased loading from a SDA, a dry ESP is not a good technological match for Fort Churchill 1.

**Wet Electrostatic Precipitator.** While wet ESP operation is similar to the dry ESP through the charging and collection of flue gas particles, the wet technology has major advantages. The wet ESP is not sensitive to particulate resistivity and can accommodate changes in particulate loading more easily than a dry ESP. Collection plates can be fabricated from metal or fabric, and the collected particulate is washed off the plates with water.

Wet ESPs have successfully been demonstrated on similar oil particulate or chemical mist applications. However, flue gas leaving the wet ESP will be saturated and may result in a visual steam plume exiting the stack. The wet ESP will utilize water to collect and remove the particles, and will produce a wastewater by-product.

While the wet ESP PM<sub>10</sub> emission level is estimated to be similar to a fabric filter without SDA operation, increased particulate loading from an SDA may not allow a wet ESP to meet required collection efficiency. Therefore, a wet ESP is not a technically acceptable alternative when matched with an SDA.

**Fabric Filter.** Fabric filter technology achieves particulate reduction through the filtration of the flue gas through filter bags. The collected particles are periodically removed from the bag through a pulse jet or reverse flow mechanism. A pulse jet filtration system would likely be selected for installation on Fort Churchill 1 because this fabric filter technology results in lower capital cost and a smaller required footprint.

Because of the somewhat sticky particles produced during oil firing, appropriate fabric and/or coating bags with a suitable pre-coat material are imperative. If fabric bags become "blinded" due to allowing hard-to-remove particles to become embedded in the fabric structure, total bag replacement may be necessary. Blinded bags will continue to provide excellent filtration efficiencies; however, the pressure drop across the fabric may exceed system draft capability.

While a fabric filter is not an acceptable alternative for PM<sub>10</sub> emissions control for an oil-fired unit without utilization of coating material, it is anticipated to function satisfactorily with a pre-coat and the increased particulate loading from the SDA operation.

### 3.2.3.3 Step 3: Evaluate Control Effectiveness of Remaining Control Technologies

The PM<sub>10</sub> control technology emission rates are summarized in Table 3-6.

**TABLE 3-6**  
PM<sub>10</sub> Control Technology Emission Rates  
Fort Churchill Unit 1

Control Technology	Expected PM <sub>10</sub> Emission Rate (Lb/MMBtu)
Current Title V Permit Limit (converted to lb/MMBtu for comparison)	0.194 (1-hr average)
NVE BART Limit (Switch to No. 2 Fuel Oil w/LNB)	0.03 (3-hr average)
Fabric Filter (only with SDA installation)	0.015

### 3.2.3.4 Step 4: Evaluate Impacts and Document the Results

This step involves the consideration of energy, environmental, and economic impacts associated with each control technology. The remaining useful life of the plant is also considered during the evaluation.

**Energy Impacts.** No additional energy impact is expected from PM<sub>10</sub> reduction as a result of new LNB or burning of low sulfur fuel oil. A fabric filter and ductwork will add an estimated 6-8 inches of H<sub>2</sub>O pressure drop to the system and additional electrical load requirements for No. 6 fuel oil combustion.

No energy impact costs are included in the economic analysis presented in Appendix A.

**Environmental Impacts.** There are no negative environmental impacts from the utilization of new LNB, switching to low sulfur diesel fuel, or utilizing a fabric filter.

No environmental impact costs have been quantified in the economic analysis presented in Appendix A.

**Economic Impacts.** A summary of the costs and PM<sub>10</sub> removed for the alternatives is recorded in Table 3-7.

**TABLE 3-7**  
 PM<sub>10</sub> Control Cost Comparison  
 Fort Churchill Unit 1

<b>Factor</b>	<b>Fabric Filter</b>	<b>Switch to Low Sulfur Fuel</b>
Total Installed Capital Costs	\$22,000,000	\$500,000
Total First Year Fixed & Variable O&M Costs	\$332,552	-
Total First Year Annualized Cost	\$2,665,784	-
Power Consumption (MW)	0.40	-
Annual Power Usage (Million kW-Hr/Yr)	1.8	-
PM <sub>10</sub> Design Control Efficiency	46.0%	-
Tons PM <sub>10</sub> Removed per Year	35	-
First Year Ave Control Cost (\$/Ton PM <sub>10</sub> Removed)	77,232	-
Incremental Control Cost (\$/Ton PM <sub>10</sub> Removed)	77,232	-

The complete Economic Analysis is contained in Appendix A.

### 3.2.3.5 Step 5: Evaluate Visibility Impacts

Please see Section 4.0, BART Modeling Analysis.

## 3.3 Summary

The most cost-effective emissions control scenario includes the utilization of LNB with PNG and/or low-sulfur No. 2 fuel oil. The Nevada Public Utilities Commission has mandated that Fort Churchill Unit 1 maintain the capability to use both PNG and fuel oil. However, as a first step in the BART implementation plan, NV Energy has committed to use only low-sulfur No. 2 fuel oil.

# 4.0 BART Modeling Analysis

---

## 4.1 Introduction

This section presents the dispersion modeling methods and results for estimating the degree of visibility improvement from BART control technology options for NV Energy Fort Churchill 1.

To a large extent, the modeling followed the methodology outlined in the Western Regional Air Partnership (WRAP) protocol for performing BART analyses (WRAP, 2006). Any proposed deviations from that methodology are documented in the modeling protocol that is included as Appendix B to this report.

## 4.2 Model Selection

CH2M HILL used the Gaussian puff dispersion model (CALPUFF) modeling system to assess the visibility impacts at Class I areas. Work groups that represent the interests of the Federal Land Managers (FLM) recommend that an analysis of Class I area air quality and air quality related values (AQRVs) be performed for major sources located more than 50 km from these areas (EPA, 1998). The CALPUFF model is routinely recommended for these types of regulatory analyses.

The CALPUFF modeling system includes the meteorological data preprocessing program for CALPUFF (CALMET) with algorithms for chemical transformation and deposition, and a post processor capable of calculating concentrations, visibility impacts, and deposition (CALPOST). The CALPUFF modeling system was applied in a full, refined mode.

CH2M HILL used the latest version (Version 6) of the CALPUFF modeling system preprocessors and models in lieu of the EPA-approved versions (Version 5). The FLMs and others have noted that the EPA-approved Version 5 contained errors and that a newer version should be used. Consequently, it was decided to use the latest (as of April 2006) version of the CALPUFF modeling system (available at [www.src.com](http://www.src.com)):

- CALMET Version 6.211 Level 060414
- CALPUFF Version 6.112 Level 060412

CALMET, CALPUFF, CALPOST, and POSTUTIL were recompiled with the Lahey/Fujitsu Fortran 95 Compiler (Release 7.10.02) to accommodate the large CALMET domain. The recompiled processors were tested against the test case results provided with the source code (TRC, 2007), and the difference between the results was 0.03 percent.

## 4.3 CALMET Methodology

### 4.3.1 Dimensions of the Modeling Domain

CH2M HILL defined domains for Mesoscale Meteorological Model, Version 5 (MM5), CALMET, and CALPUFF that were slightly different than those established for the Nevada BART modeling in WRAP (2006). In addition, the CALMET and CALPUFF Lambert Conformal Conic (LCC) map projection is based on a central meridian of 117° W rather than 97° W. This puts the central meridian near the center of the domain.

CH2M HILL used the CALMET model to generate three-dimensional wind fields and other meteorological parameters suitable for use by the CALPUFF model. A CALMET modeling domain has been defined to allow for at least a 50-km buffer around all Class I areas within 300 km of the Fort Churchill Power Plant. Grid resolution for this domain was 4 km.

Figure 4-1 shows the extent of the modeling domain.

The technical options recommended in WRAP (2006) were used for CALMET. Vertical resolution of the wind field included 11 layers, with vertical cell face heights as follows (in meters):

- 0, 20, 100, 200, 350, 500, 750, 1000, 2000, 3000, 4000, 5000

Also, following WRAP (2006), ZIMAX were set to 4,500 meters based on the Colorado Department of Health and Environment (CDPHE) analyses of soundings for summer ozone events in the Denver area (CDPHE, 2005). The CDPHE analysis suggests mixing heights in the Denver area are often well above the CALMET default value of 3,000 meters during the summer. For example, on some summer days, ozone levels are elevated all the way to 6,000 meters mean sea level (MSL) or beyond during some meteorological regimes, including some regimes associated with high-ozone episodes. It is assumed that, as in Denver, mixing heights in excess of the 3,000 m AGL CALMET default maximum would occur in the domain used for this analysis.

**FIGURE 4-1**  
 Ft. Churchill Power Plant, CALMET/CALPUFF Domain

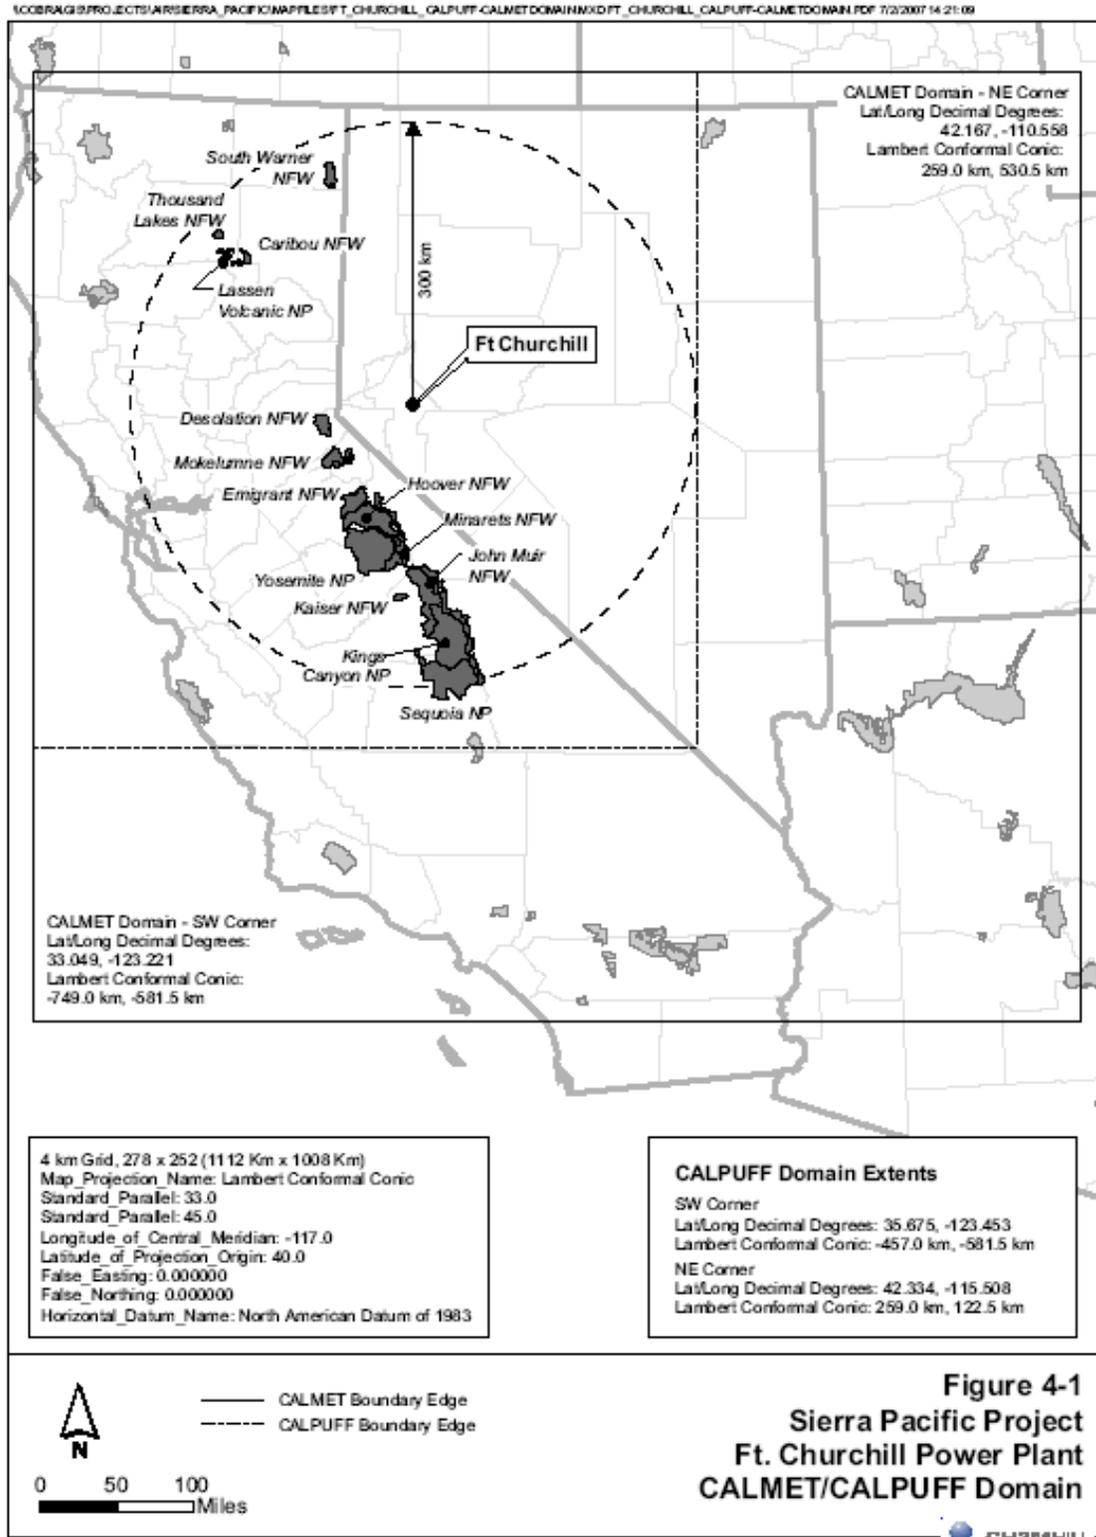


Table 4-1 lists the key user-specified options.

**TABLE 4-1**  
User-Specified CALMET Options  
*Fort Churchill Unit 1*

Description	CALMET Input Parameter	Value
<b>CALMET Input Group 2</b>		
Map projection	PMAP	Lambert Conformal Conic (LCC)
Grid spacing	DGRIDKM	4
Number vertical layers	NZ	11
Top of lowest layer (m)		20
Top of highest layer (m)		5000
<b>CALMET Input Group 4</b>		
Observation mode	NOOBS	1
<b>CALMET Input Group 5</b>		
Prognostic or MM-FDDA data switch	I PROG	14
Max surface over-land extrapolation radius (km)	RMAX1	50
Max aloft over-land extrapolations radius (km)	RMAX2	100
Radius of influence of terrain features (km)	TERRAD	10
Relative weight at surface of Step 1 field and obs	R1	100
Relative weight aloft of Step 1 field and obs	R2	200
<b>CALMET Input Group 6</b>		
Maximum over-land mixing height (m)	ZIMAX	4500

### 4.3.2 CALMET Input Data

CH2M HILL ran the CALMET model to produce 3 years of analysis: 2001, 2002, and 2003. CH2M HILL used MM5 data as the basis for the CALMET wind fields. The horizontal resolution of the MM5 data is 36 km.

For 2001, CH2M HILL used MM5 data at 36-km resolution that were obtained from the contractor (Alpine Geophysics) who developed the nationwide data for the EPA. For 2002, CH2M HILL used 36-km MM5 data obtained from Alpine Geophysics, originally developed for the WRAP. Data for 2003 (also from Alpine Geophysics), at 36-km resolution, were developed by the Wisconsin Department of Natural Resources, the Illinois Environmental Protection Agency, and the Lake Michigan Air Directors Consortium (Midwest RPO).

The MM5 data were used as input to CALMET as the “initial guess” wind field. The initial guess field was adjusted by CALMET for local terrain and land use effects to generate a Step 1 wind field, and then further refined using local surface observations to create a final Step 2 wind field.

Surface data for 2001-2003 were obtained from the National Climatic Data Center (NCDC). CH2M HILL processed data for all stations from the National Weather Service’s (NWS) Automated Surface Observing System (ASOS) network that are in the domain. The surface

data were obtained in abbreviated DATSAV3 format. A conversion routine available from the TRC website was used to convert the DATSAV3 files to CD 144 format for input to the SMERGE preprocessor and CALMET.

Land use and terrain data were obtained from the U.S. Geological Survey (USGS). Land use data were obtained in Composite Theme Grid (CTG) format from the USGS, and the Level I USGS land use categories were mapped into the 14 primary CALMET land use categories. Surface properties, such as albedo, Bowen ratio, roughness length, and leaf area index, were computed from the land use values. Terrain data were taken from USGS 1 degree Digital Elevation Model (DEM) data, which are primarily derived from USGS 1:250,000 scale topographic maps. Missing land use data were filled with a value that is appropriate for the missing area.

Precipitation data were ordered from the NCDC. All available data in fixed-length, TD-3240 format were ordered for the modeling domain. The list of available stations and stations that have collected complete data varies by year, but CH2M HILL processed all available stations/data within the domain for each year. Precipitation data were prepared with the PEXTRACT/PMERGE processors in preparation for use within CALMET.

Following the methodology recommended in WRAP (2006), no observed upper-air meteorological observations were used as they are redundant to the MM5 data and may introduce spurious artifacts in the wind fields. In the development of the MM5 data, the twice daily upper-air meteorological observations were used as input with the MM5 model. The MM5 estimates were nudged to the upper-air observations as part of the Four Dimensional Data Assimilation (FDDA). This results in higher temporal (hourly vs. 12 hour) and spatial (36 km vs. ~300 km) resolution for the upper-air meteorology in the MM5 field. These MM5 data are more dynamically balanced than those contained in the upper-air observations. Therefore, the use of the upper-air observations with CALMET is not needed, and, in fact, will upset the dynamic balance of the meteorological fields potentially producing spurious vertical velocities.

### **4.3.3 Validation of CALMET Wind Field**

CH2M HILL used the CalDESK (program to display data and results) data display and analysis system (v2.97, Enviromodeling Ltda.) to view plots of wind vectors and other meteorological parameters to evaluate the CALMET wind fields. We used observed weather conditions, as depicted in surface and upper-air weather maps from the National Oceanic and Atmospheric Administration (NOAA) Central Library U.S. Daily Weather Maps Project ([http://docs.lib.noaa.gov/rescue/dwm/data\\_rescue\\_daily\\_weather\\_maps.html](http://docs.lib.noaa.gov/rescue/dwm/data_rescue_daily_weather_maps.html)), to compare to the CalDESK displays.

## **4.4 CALPUFF Methodology**

### **4.4.1 CALPUFF Modeling**

CH2M HILL ran the CALPUFF model with the meteorological output from CALMET over the CALPUFF modeling domain (Figure 4-1). The CALPUFF model was used to predict visibility impacts for the pre-control (baseline) scenario for comparison to the predicted impacts for post-control scenarios.

#### 4.4.1.1 Background Ozone and Ammonia

Hourly values of background ozone concentrations were used by CALPUFF for the calculation of SO<sub>2</sub> and NO<sub>x</sub> transformation with the MESOPUFF II chemical transformation scheme. CH2M HILL used the hourly ozone data generated for the WRAP BART analysis for 2001, 2002, and 2003.

For periods of missing hourly ozone data, the chemical transformation relied on a monthly default value of 80 parts per billion (ppb). Background ammonia was set to 1 ppb as recommended in WRAP (2006).

#### 4.4.1.2 Stack Parameters

The baseline stack parameters for the baseline and post-control scenarios were the same as those used the WRAP Regional Modeling Center (RMC) analyses. None of the emission controls included in this BART analysis would have a major effect on exhaust exit flows or temperatures.

#### 4.4.1.3 Pre-Control Emission Rates

Pre-control emission rates reflect normal maximum capacity 24-hour emissions that may occur under the source's current permit. The emission rates reflect actual emissions under normal operating conditions. As described by the EPA in the Regional Haze Regulations and Guidelines for BART Determinations; Final Rule (40 CFR Part 51; July 6, 2005, pg. 39129):

*"The emissions estimates used in the models are intended to reflect steady-state operating conditions during periods of high-capacity utilization. We do not generally recommend that emissions reflecting periods of start-up, shutdown, and malfunction be used..."*

CH2M HILL selected the emissions rates used in the WRAP RMC modeling as the Pre-control (baseline) emission rates. The WRAP PM<sub>10</sub> and SO<sub>2</sub> were speciated to determine emission rates for coarse particulate, fine particulate, elemental carbon, organic aerosols, and sulfates.

Emissions were modeled for the following species:

- Sulfur dioxide (SO<sub>2</sub>)
- Nitrogen oxides (NO<sub>x</sub>)
- Coarse particulate (PM<sub>2.5</sub> < diameter ≤ PM<sub>10</sub>)
- Fine particulate (diameter ≤ PM<sub>2.5</sub>)
- Elemental carbon (EC)
- Organic aerosols (SOA)
- Sulfates (SO<sub>4</sub>)

#### 4.4.1.4 Post-control Emission Rates

Post-control emission rates represent the NVE BART Limit emission levels presented in Table 5-1, with the exception of the NO<sub>x</sub> emission rate which is in excess of the NVEBL.

#### 4.4.1.5 Modeling Process

The CALPUFF modeling for the control technology options followed this sequence:

- Model WRAP-RMC parameters to verify results
- Model Title V Permit Limits

Model Scenario 1 (NVE BART Limit) emissions, with the exception of the NO<sub>x</sub> emission rate which is in excess of the NVEBL.

- Determine the degree of visibility improvement

#### 4.4.2 Receptor Grids and Coordinate Conversion

The TRC COORDS program was used to convert the latitude/longitude coordinates to LCC coordinates for the meteorological stations and source locations. The USGS conversion program PROJ (version 4.4.6) was used to convert the National Park Service (NPS) receptor location data from latitude/longitude to LCC.

For the Class I areas that are within 300 km of the Fort Churchill Power Plant, discrete receptors for the CALPUFF modeling were taken from the NPS database for Class I area modeling receptors. The entire area of each Class I area that is within or intersects the 300-km circle (Figure 3-1) were included in the modeling analysis. The following Class I areas were modeled for the Fort Churchill facility:

- Ansel Adams Wilderness (Minarets Wilderness) (anad)
- Caribou Wilderness (cari)
- Desolation Wilderness (deso )
- Emigrant Wilderness (emig)
- Hoover Wilderness (hoov)
- John Muir Wilderness (jomu)
- Kaiser Wilderness (kais)
- Kings Canyon NP (kica)
- Lassen Volcanic NP (lavo)
- Mokelumne Wilderness (moke)
- Sequoia NP (sequ)
- South Warner Wilderness (sowa)
- Thousand Lakes Wilderness (thla)
- Yosemite NP (yose)

### 4.5 Visibility Post-processing

#### 4.5.1 CALPOST

The CALPOST processor was used to determine 24-hour average visibility results. Output is specified in deciview (dv) units.

Calculations of light extinction were made for each pollutant modeled. The sum of all extinction values was used to calculate the delta-dv ( $\Delta dv$ ) change relative to natural background. Default extinction coefficients for each species, as shown below, were used:

- Ammonium sulfate 3.0
- Ammonium nitrate 3.0
- PM coarse (PM<sub>10</sub>) 0.6
- PM fine (PM<sub>2.5</sub>) 1.0
- Organic carbon 4.0
- Elemental carbon 10.0

CALPOST visibility Method 6 (MVISBK=6) was used for the determination of visibility impacts. Monthly average relative humidity factors [f(RH)] were used in the light extinction calculations to account for the hygroscopic characteristic of sulfate and nitrate particles. Monthly f(RH) values, from the WRAP\_RMC BART modeling, were used in CALPOST for the particular Class I area being modeled.

The natural background conditions used in the post-processing to determine the change in visual range background - or delta-deciview ( $\Delta dv$ ) - represent the average natural background concentration for western Class I areas.

Table 4-2 lists the annual average species concentrations from the EPA Guidance.

**TABLE 4-2**  
Average Natural Levels of Aerosol Components  
*Fort Churchill Unit 1*

Aerosol Component	Average Natural Concentration ( $\mu\text{g}/\text{m}^3$ ) for Western Class I Areas
Ammonium Sulfate	0.12
Ammonium Nitrate	0.10
Organic Carbon	0.47
Elemental Carbon	0.02
Soil	0.50
Coarse Mass	3.0

<sup>a</sup> Taken from Table 2-1 of Guidance for Estimating Natural Visibility Conditions Under the Regional Haze Rule. EPA-454/B-03-005, September 2003.

## 4.6 Results

Input and output files for the CALMET/CALPUFF modeling and post-processing will be provided upon request.

### 4.6.1 WRAP Verification Runs Results

Tables 4-3 and 4-4 present the results of WRAP-RMC model verification runs. The results show good correlation in estimated maximum  $\Delta dv$ . Much of the difference between these values is probably attributed to the different alignment of the LCC grids (reference discussion in Section 4.3.1).

**TABLE 4-3**  
 Results from WRAP-RMC CALPUFF Modeling for Fort Churchill Boilers 1 and 2 (WRAP 2007)  
 Fort Churchill Unit 1

Class I Area	Min Distance (km)	Max Delta $\Delta$ dv	98 <sup>th</sup> Percentile $\Delta$ dv	Days > 0.5 $\Delta$ dv	98 <sup>th</sup> Percentile $\Delta$ dv for Each Year			98 <sup>th</sup> $\Delta$ dv 3-year Avg
					2001	2002	2003	
moke	78	3.77	0.94	69	0.76	1.24	0.84	0.95
deso	85	2.81	1.14	72	0.89	1.25	1.12	1.09
hoov	99	2.59	0.61	30	0.53	1.00	0.40	0.64
emig	100	2.38	0.53	25	0.40	0.68	0.36	0.48
yose	112	2.42	0.68	29	0.44	1.00	0.42	0.62
anad	132	2.37	0.56	28	0.44	0.70	0.39	0.51
jomu	169	1.79	0.53	24	0.39	0.56	0.53	0.49
kais	200	1.35	0.38	11	0.28	0.43	0.24	0.32
kica	212	2.29	0.41	12	0.35	0.43	0.40	0.39
cari	226	1.86	0.77	34	0.76	0.77	0.69	0.74
lavo	231	1.72	0.77	33	0.69	0.77	0.67	0.71
sowa	245	4.42	0.79	62	1.01	0.72	0.78	0.84
thla	265	1.27	0.50	21	0.60	0.46	0.46	0.50
sequ	274	1.84	0.37	9	0.29	0.40	0.38	0.36

**TABLE 4-4**  
 Verification CALPUFF Modeling Results  
 Fort Churchill Unit 1

Class I Area	Min Distance (km)	Max Delta $\Delta$ dv	98 <sup>th</sup> Percentile $\Delta$ dv	Days > 0.5 $\Delta$ dv	98 <sup>th</sup> Percentile $\Delta$ dv for Each Year			98 <sup>th</sup> $\Delta$ dv 3-year Avg
					2001	2002	2003	
moke	79	3.57	1.60	63	1.17	1.93	1.71	1.60
deso	86	3.80	1.62	60	1.20	1.91	1.37	1.49
hoov	99	2.07	0.94	35	0.89	1.03	0.79	0.90
emig	101	1.99	0.95	30	0.92	1.19	0.79	0.97
yose	112	2.02	0.83	31	0.79	1.04	0.66	0.83
anad	133	1.90	0.59	13	0.56	0.64	0.56	0.59
jomu	170	1.44	0.66	24	0.62	0.80	0.70	0.71
kais	200	1.29	0.43	7	0.45	0.39	0.42	0.42
kica	212	1.23	0.65	16	0.66	0.59	0.62	0.62
cari	227	1.82	0.86	20	1.28	0.80	0.86	0.98
lavo	231	1.82	0.83	19	1.19	0.79	0.87	0.95
sowa	246	2.74	1.05	28	1.26	0.93	1.00	1.07
thla	266	1.65	0.66	13	0.72	0.58	0.61	0.63
sequ	274	1.32	0.70	14	0.71	0.71	0.66	0.69

## 4.6.2 BART Modeling Analysis

The results and comparisons of the CALPUFF modeling for the baseline emission rates and those for the NVE BART Limit emission rates are provided in Section 5. As previously mentioned, the NO<sub>x</sub> emission rate modeled is in excess of the NVEBL.

# 5.0 BART Analysis and Recommendations

## 5.1 Recommended BART Controls

As a result of the completed technical and economic evaluations, and consideration of the modeling analysis for Fort Churchill 1, the recommended BART controls include installing LNB for NO<sub>x</sub> and utilizing PNG and/or low-sulfur No. 2 fuel oil for SO<sub>2</sub> and PM<sub>10</sub> emissions reduction. There are no presumptive limits assigned by the United States Environmental Protection Agency (EPA) for wall-fired boilers burning PNG or fuel oil. In the absence of a specific Federal guidance, Nevada has chosen to establish the NVEBL based on the control technology that meets the BART guidelines for each specific unit.

Table 5-1 compares the baseline emission control scenario with expected emission levels utilizing the NVE BART Limit emission levels. While the NO<sub>x</sub> emission rate modeled is in excess of the current NVEBL, modeling results represent worst case visibility impacts. Because of the basis utilized to establish the estimated emissions rate for each of these cases, it is important to consider economic and dispersion modeling results for each scenario in making the overall BART recommendation.

The WRAP baseline represents a snap-shot view of emissions based upon the year 2006, and does not necessarily represent worst case potential emission rates. The Title V permit limit offers a more representative view of maximum potential emission rates, since these are enforceable operating limits. Comparison of dispersion modeling results for the three scenarios are presented below.

**TABLE 5-1**  
Modeled Emission Control Scenarios  
*Fort Churchill Unit 1*

Case	Estimated NO <sub>x</sub> Emissions (lb/MMBtu)	Estimated SO <sub>2</sub> Emissions (lb/MMBtu)	Estimated PM <sub>10</sub> Emissions (lb/MMBtu)
WRAP Baseline	0.434	0.582	0.019
Title V Emission Limit Baseline	0.8	0.8	0.194
Scenario 1 – NVE BART Limit BART	0.40 <sup>a</sup>	0.05	0.03

<sup>a</sup> – NO<sub>x</sub> emission rate higher than NVEBL

The ranking of the different NO<sub>x</sub> emission control scenarios based on annual costs, from lowest to highest cost, is presented on Table 5-2.

**TABLE 5-2**  
 Ranking of NO<sub>x</sub> Control Scenarios by Cost  
 Fort Churchill Unit 1

Rank	Scenario	Total Annual Cost
1	LNB	\$156,559
2	LNB w/FGR	\$490,970
3	New LNB and SNCR	\$893,203
4	ROFA with Rotamix	\$1,669,757
5	New LNB and SCR	\$4,499,854


## 5.2 Dispersion Modeling Results

The results of the dispersion modeling are shown below. In this analysis the WRAP emission rates are used as a historical baseline. Table 5-3 compares visibility impacts of the WRAP baseline, the current Title V permit limits and the NVE BART Limit emission rates. The NVE BART Limit emission rates for Fort Churchill Unit 1 demonstrate an improvement in visibility.


**TABLE 5-3**  
 Comparison of Visibility Impacts by Class I Area  
*Fort Churchill Unit 1*

Area	Distance (km)	98 <sup>th</sup> Percentile Adv			Number of Days Exceeding 0.5 Adv		
		WRAP Baseline	Title V Permit Limit	NVE BART Limit	WRAP Baseline	Title V Permit Limit	NVE BART Limit
moke	79	1.07	1.64	0.58	41	66	14
deso	86	1.02	1.58	0.54	29	57	15
hoov	99	0.55	0.89	0.27	13	27	1
emig	101	0.57	0.88	0.27	14	28	3
yose	112	0.48	0.75	0.24	11	27	2
anad	133	0.32	0.50	0.14	4	11	1
jomu	170	0.36	0.58	0.18	4	14	0
kais	200	0.22	0.35	0.09	1	3	0
kica	212	0.36	0.56	0.17	5	10	0
cari	227	0.48	0.78	0.25	9	15	3
lavo	231	0.48	0.77	0.25	9	15	3
sowa	246	0.62	1.00	0.35	15	23	5
thla	266	0.36	0.55	0.17	5	11	1
sequ	274	0.38	0.59	0.18	4	10	1


**FIGURE 5-1**  
 Comparison of 98<sup>th</sup> Percentile Delta Deciview Visibility Impacts Part 1  
 Fort Churchill 1

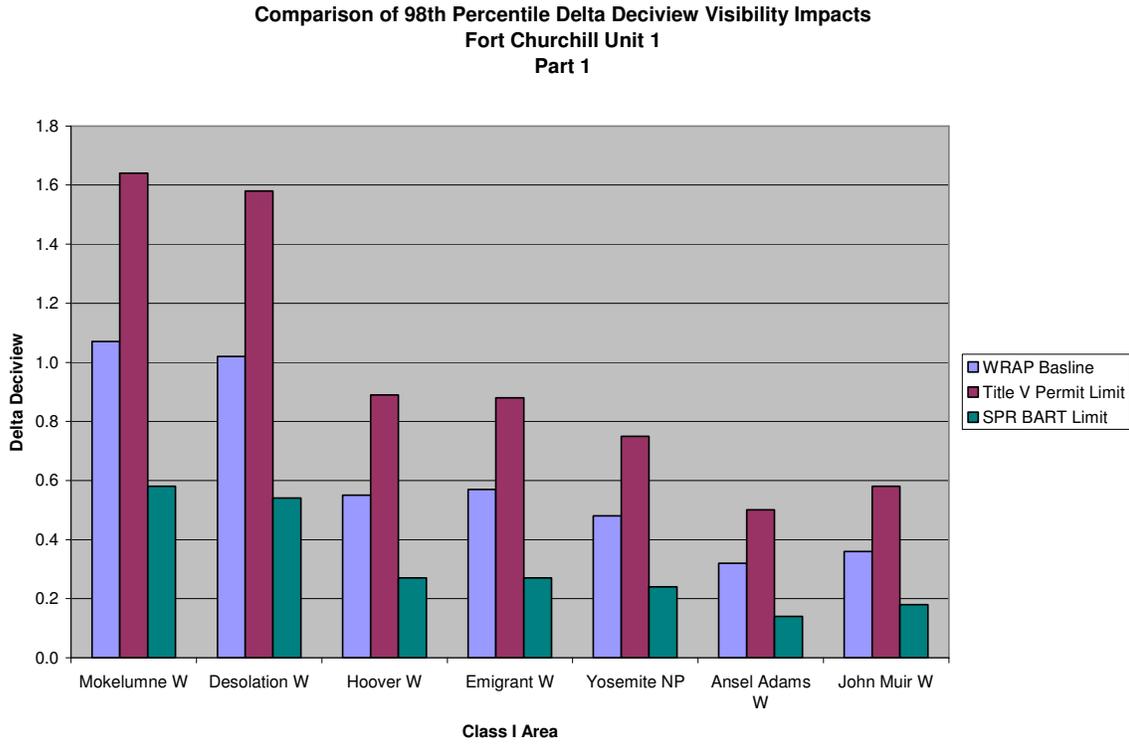


**FIGURE 5-2**  
 Comparison of 98<sup>th</sup> Percentile Delta Deciview Visibility Impacts Part 2  
 Fort Churchill 1

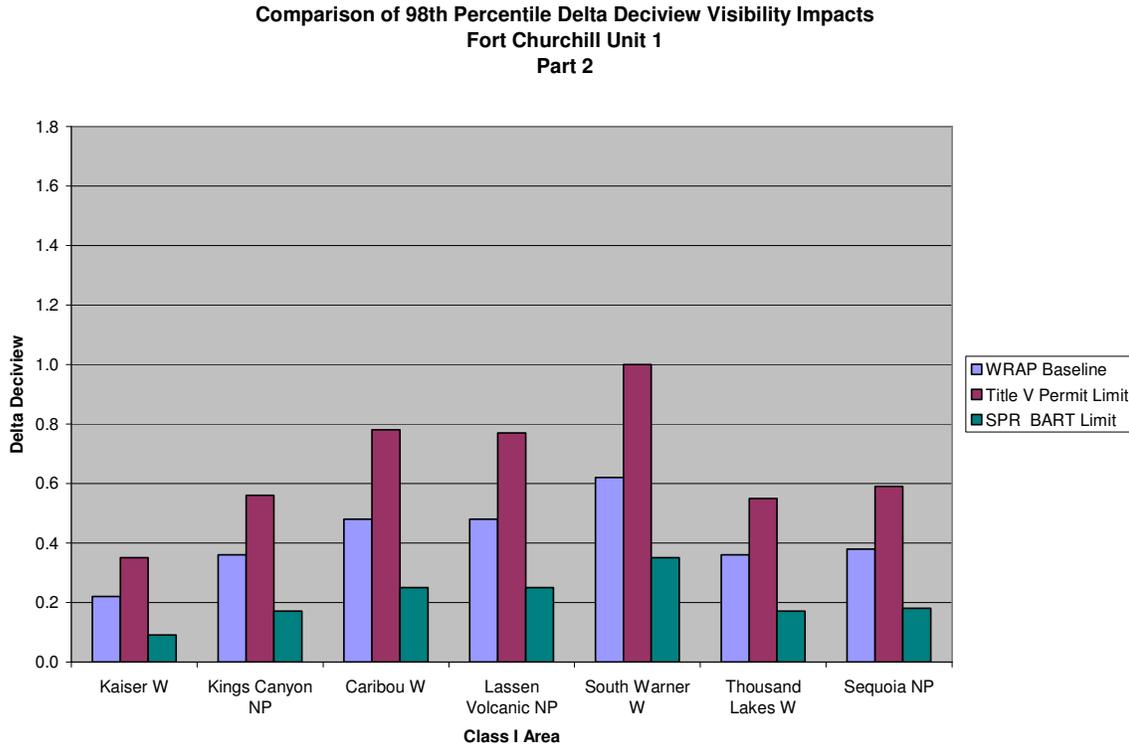

**FIGURE 5-3**  
 Comparison of Days of Visibility Impacts Exceeding 0.5  $\Delta$ dv Part 1  
 Fort Churchill 1

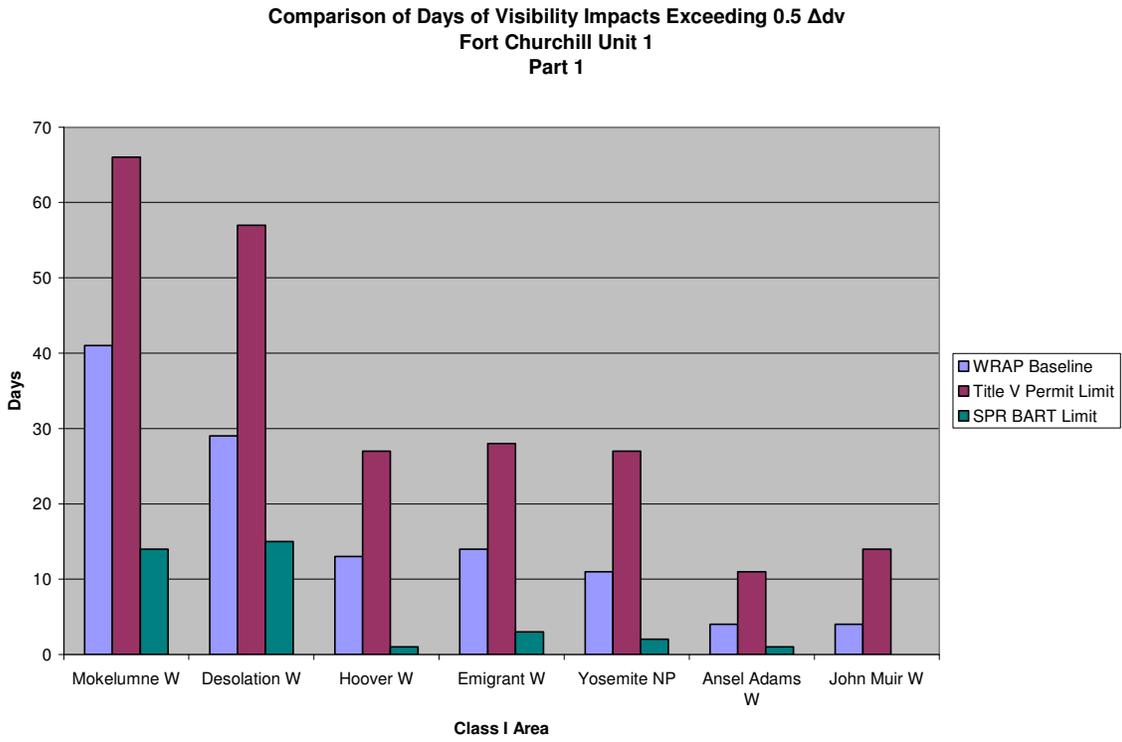

**FIGURE 5-4**  
 Comparison of Days of Visibility Impacts Exceeding 0.5  $\Delta$ dv Part 2  
 Fort Churchill 1

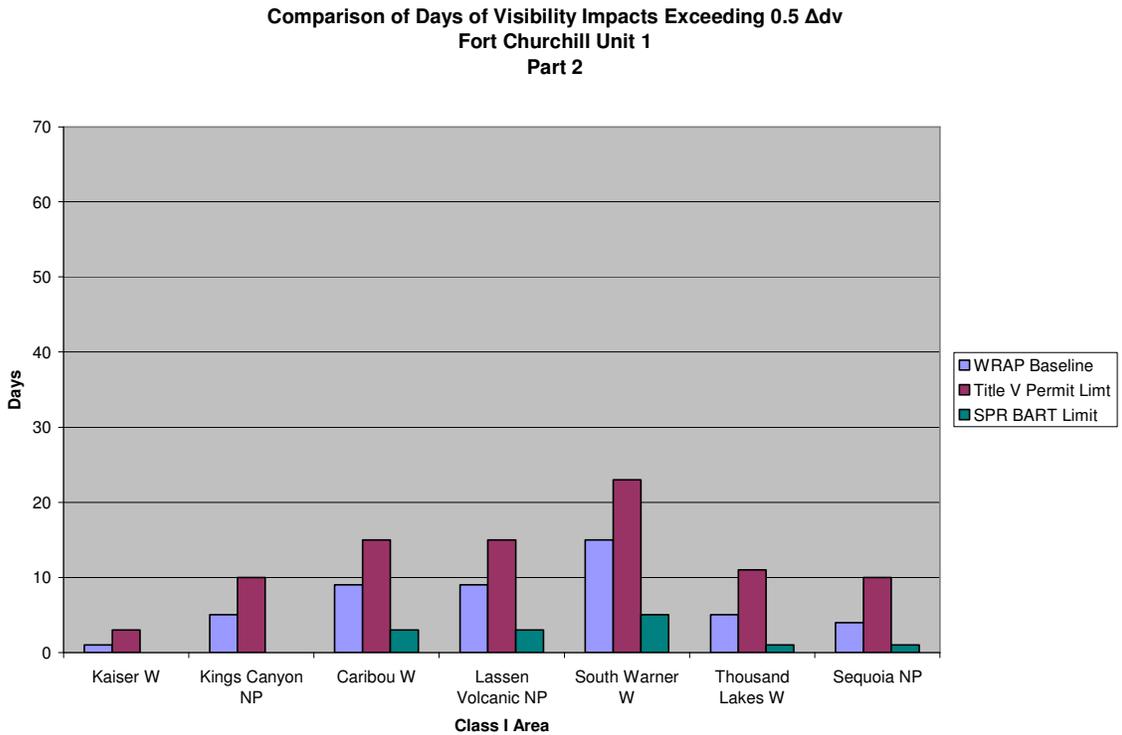

As shown in Figures 5-1 through 5-4, there is a significant decrease in modeled visibility impact when reducing the modeled emission levels from the WRAP and Title V Permit values, to the NVEBL emission rates.

### 5.2.1 NO<sub>x</sub> Control Scenario Visibility Modeling

While visibility modeling has not been completed for the combination of NO<sub>x</sub>, SO<sub>2</sub>, and PM<sub>10</sub> NBEBL values, Tables 5-4 and 5-5 below compare the results for the various NO<sub>x</sub> control technologies. Results from two representative Class I areas are provided.

Based on an evaluation of the cost per  $\Delta$ dv reduction from Tables 5-4 and 5-5, new LNB is selected as BART for Fort Churchill 1.

**TABLE 5-4**

NO<sub>x</sub> Control Scenario Results for Mokelumne Wilderness  
Fort Churchill Unit 1

Scenario	Controls	Average Number of Days Above 0.5 $\Delta$ dV (Days)	98th Percentile $\Delta$ dV Reduction	Total Annualized Cost (Million\$)	Cost per $\Delta$ dV Reduction (Million\$/dV Reduced)
Base		27	0	0	0
1	New LNB	17	0.296	0.157	0.529
2	New LNB and FGR	12	0.332	0.491	1.479
3	New LNB and SNCR	12	0.362	0.893	2.467
4	New LNB and SCR	6	0.5	4.500	9.000

TABLE 5-5

NO<sub>x</sub> Control Scenario Results for Yosemite NP  
Fort Churchill Unit 1

Scenario	Controls	Average Number of Days Above 0.5 ΔdV (Days)	98th Percentile ΔdV Reduction	Total Annualized Cost (Million\$)	Cost per ΔdV Reduction (Million\$/dV Reduced)
Base		8	0	0	0
1	New LNB	2	0.129	0.157	1.214
2	New LNB and FGR	2	0.144	0.491	3.410
3	New LNB and SNCR	2	0.159	0.893	5.618
4	New LNB and SCR	0	0.218	4.500	20.642

## 5.3 Recommendations

### 5.3.1 NO<sub>x</sub> Emission Control

New LNB has been selected as the NO<sub>x</sub> reduction technology with an NVEBL of 0.28 lb/MMBtu averaged on an annual basis. NewLNB is based on utilizing enhanced combustion to meet the proposed NVEBL. There is significant uncertainty involved in obtaining vendor emission guarantees and associated equipment/construction costs at this stage of analysis when retrofitting older boiler units. Site specific engineering is required on a "unit by unit" basis to determine the most effective control technology.

### 5.3.2 SO<sub>2</sub> Emission Control

The utilization of PNG and/or low-sulfur No. 2 fuel oil is BART for Fort Churchill 1 with an NVEBL of 0.05 lb/MMBtu averaged on a 24-hour basis. No additional SO<sub>2</sub> emission control is required. No. 6 fuel oil will no longer be burned at the facility.

### 5.3.3 PM<sub>10</sub> Emission Control

The utilization of PNG and/or low-sulfur No. 2 fuel oil is BART for Fort Churchill 1 with an NVEBL of 0.03 lb/MMBtu averaged on a 3-hour basis. No additional PM<sub>10</sub> emission control is required. No. 6 fuel oil will no longer be burned at the facility.

## 5.4 Just-Noticeable Differences in Atmospheric Haze

Conclusions reached in the reference document *Just-Noticeable Differences in Atmospheric Haze* by Dr. Ronald Henry of the University of Southern California (Henry, 2002), state that only dV differences of approximately 1.5 to 2.0 dV, or more are perceivable by the human eye. Deciview changes of less than 1.5 cannot be distinguished by the average person.

Therefore, the modeling analysis results indicate that only minimal, if any, observable visibility improvements at the Class I areas studied would be expected under any of the scenarios. Thus the results indicate that even though many millions of dollars will be spent, only minimal, if any, noticeable visibility improvements may result.

Finally, it should be noted that none of the data were corrected for natural obscuration where water in various forms (fog, clouds, snow, or rain) or other naturally caused aerosols obscure the atmosphere. During the period of 2001 through 2003, there were several mega-wildfires that lasted for many days and could have had a major impact of background visibility in these Class I areas. If natural obscuration were to reduce the reduction in visibility impacts modeled for the Fort Churchill 1 facility, the effect would be to increase the costs per  $\Delta dV$  reduction that are presented in this report.

## 6.0 References

---

40 CFR Part 51. 2005. *Regional Haze Regulations and Guidelines for Best Available Retrofit Technology Determinations; Final Rule* (July 6, 2005, pg 39129).

United States Environmental Protection Agency. 1990. *New Source Review Workshop Manual – Prevention of Significant Deterioration and Nonattainment Area Permitting*. October 1990.

EPA. 1998. *Interagency Workgroup on Air Quality Modeling (IWAQM) Phase 2 Summary Report and Recommendations for Modeling Long-Range Transport Impacts*. Air Quality Modeling Group (MD-14), Research Triangle Park, North Carolina; National Park Service, Air Resources Division, Denver, Colorado; USDA Forest Service, Air Program, Fort Collins, Colorado; and U.S. Fish and Wildlife Service, Air Quality Branch, Denver, Colorado. December 1998.

*Guidance for Estimating Natural Visibility Conditions Under the Regional Haze Rule*.

Henry, Ronald C. 2002. "Just-Noticeable Differences in Atmospheric Haze." *Journal of the Air and Waste Management Association* 52:1238-1243. October 2002

Western Regional Air Partnership (WRAP). 2007. *Summary of WRAP RMC BART Modeling for Nevada, Draft#8*. May 14, 2007.

WRAP. 2006. *Draft Final Modeling Protocol, CALMET/CALPUFF Protocol for BART Exemption Screening Analysis for Class I Areas in the Western United States*. Air Quality Modeling Forum. Regional Modeling Center. August 15, 2006.

# Appendices

---

APPENDIX A

# Economic Analysis

---

APPENDIX B  
**BART Protocol**

---